

Report on Short-term Power Market in India: 2019-20



**Economics Division
Central Electricity Regulatory Commission**



*The contents from the report can be freely copied/used with due
acknowledgement to CERC*

Contents

S.No	Particulars	Page No
	Contents	i
	List of Tables	iii
	List of Figures	v
	Preface	vii
	Abbreviations	ix
	Executive Summary	xiii
	 Chapter-I: Overview of Power Sector	
1	Generation	1
2	Transmission	6
3	Distribution	9
	 Chapter-II: Short-term Power Market in India	
1	Introduction	13
2	Yearly Trends in Short-term Transactions of Electricity (2008-09 To 2019-20)	14
2.1	Total Short-term Transactions of Electricity with respect to Total Electricity Generation	15
2.1.1	<i>Electricity Transacted through Traders and Power Exchanges</i>	16
2.1.2	<i>Electricity Transacted through DSM</i>	20
2.1.3	<i>Electricity Transacted Directly between DISCOMs</i>	21
3	Monthly Trends in Short-term Transactions of Electricity (April 2019-March 2020)	22
3.1	Volume of Short-term Transactions of Electricity	23
3.2	Price of Short-term Transactions of Electricity	27
3.3	Volume of Electricity Transacted in Various Price Slabs	29
4	Daily Trends in Short-term Transactions of Electricity (1st April 2019 to 31st March 2020)	31
4.1	Volume of Short-term Transactions of Electricity	31
4.2	Price of Short-term Transactions of Electricity	32
4.2.1	<i>Price and its volatility in Power Exchanges</i>	32
4.2.2	<i>Price and its volatility in DSM</i>	33



S.No	Particulars	Page No
5	Time of the Day Variation in Volume and Price of Electricity Transacted through Traders and Power Exchanges	34
5.1	Time of the Day Variation in Volume and Price of Electricity Transacted through Traders	34
5.2	Time of the Day Variation in Volume and Price of Electricity Transacted through Power Exchanges	35
6	Trading Margin Charged by Trading Licensees	36
7	Open Access Consumers on Power Exchanges	38
7.1	Types of Participants in Power Exchanges	38
7.2	Analysis of Open Access Consumers on Power Exchanges	40
8	Major Sellers and Buyers of Electricity in the Short-term market	42
9	Effect of Congestion on the Volume of Electricity Transacted through Power Exchanges	47
10	Ancillary Services Operations	49
10.1	Background	49
10.2	Regulatory Framework of Ancillary Services	50
10.3	RRAS Instructions issued by Nodal Agency	52
10.4	RRAS Accounting and Settlement	54
	Chapter-III: Cross Border Trade of Electricity	
1	Background	57
2	Growth of Cross Border Trade of Electricity	58
	Chapter-IV: Tariff of Long-term Sources of Power	
1	Background	57
2	Tariff of Central Public Sector power generating companies	58
	Chapter-V: Trading of Renewable Energy Certificates	
1	Renewable Energy Certificate Mechanism	63
2	Trading of Renewable Energy Certificates	64
	Annexure-I :List of Transmission Licensees as on 31.03.2020	69
	Annexure-II :List of Trading Licensees as on 31.03.2020	71
	Annexure-III :Historical Volatility Formula	73
	Annexure-IV :Herfindahl-Hirschman Index	74



List of Tables

Table No.	Details	Page No.
Table-1	Installed Electricity Generation Capacity in India (GW), 2008-09 to 2019-20	1
Table-2	Sector-wise Growth of Installed Electricity Generation Capacity, 2008-09 to 2019-20	3
Table-3	Gross Electricity Generation in India (BU), 2008-09 to 2019-20	4
Table-4	Power Supply Position in India, 2008-09 to 2019-20	5
Table-5	Growth of Transmission System in India, 2008-09 to 2019-20	7
Table-6	Annual Transmission Charges, 2011-12 to 2019-20	8
Table-7	Growth of Electricity Consumption in India (Consumer category-wise) (BU), 2008-09 to 2018-19	9
Table-8	Average Cost of Supply and Average Revenue of State Power Utilities, 2008-09 to 2018-19	11
Table-9	Volume of Short-term Transactions of Electricity with respect to Total Electricity Generation, 2009-10 to 2019-20	15
Table-10	Volume of Electricity Transacted through Traders and Power Exchanges, 2008-09 to 2019-20	16
Table-11	Electricity Transacted through Traders and Power Exchanges as % of Total Short-Term Transactions, 2009-10 to 2019-20	17
Table-12	Price of Electricity Transacted through Traders and Power Exchanges 2008-09 to 2019-20	18
Table-13	Size of Short-term Power Market (Bilateral and Power Exchange)	19
Table-14	Volume and Price of Electricity transacted through DSM	20
Table-15	Volume of Electricity Transacted Directly between DISCOMs	21
Table-16	Volume of Short-term Transactions of Electricity (BU), 2019-20	23
Table-17	Volume of Short-term Transactions of Electricity as % of Total Electricity Generation, 2019-20	24
Table-18	Share of Electricity Transacted by Trading Licensees, 2019-20	25
Table-19	Price of Short-term Transactions of Electricity (₹/kWh), 2019-20	27
Table-20	Trading Margin Charged by Trading Licensees, 2009-10 to 2019-20	37



Table No.	Details	Page No.
Table-21	Number of Open Access Consumers in Power Exchanges, 2010-11 to 2019-20	40
Table-22	Volume of Purchase by Open Access Consumers in Day Ahead Market of Power Exchanges, 2010-11 to 2019-20	42
Table-23	Major Sellers of Electricity through Traders, 2019-20	43
Table-24	Major Buyers of Electricity through Traders, 2019-20	43
Table-25	Major Sellers of Electricity in Day Ahead Market of IEX, 2019-20	44
Table-26	Major Buyers of Electricity in Day Ahead Market of IEX, 2019-20	45
Table-27	Major Sellers of Electricity in Day Ahead Market of PXIL, 2019-20	45
Table-28	Major Buyers of Electricity in Day Ahead Market of PXIL, 2019-20	46
Table-29	Effect of Congestion on the Volume of Electricity Transacted through Power Exchanges, 2009-10 to 2019-20	47
Table-30	Details of Congestion in Power Exchanges, 2019-20	48
Table-31	Congestion Charges of Power Exchanges, 2008-09 to 2019-20	49
Table-32	Number of times RRAS triggered based on Triggering Criteria, 2019-20	52
Table-33	Maximum Ancillary Despatched in a Time Block (MW), 2019-20	53
Table-34	Energy Scheduled and Payments made for Ancillary Services, 2016-17 to 2019-20	54
Table-35	Growth of Cross Border Trade of Electricity, 2013-14 to 2019-20	
Table-36	Tariff of Central Thermal Power Stations, 2019-20	58
Table-37	Composite Tariff of Central Hydro Power Stations, 2019-20	61
Table-38	Floor and Forbearance Price applicable for REC Transactions	64
Table-39	Growth of RECs transacted on Power Exchanges, 2011-12 to 2019-20	65
Table-40	Demand and Supply of RECs transacted on Power Exchanges, 2012-13 to 2019-20	66
Table-41	Volume and Price of RECs transacted on Power Exchanges, 2012-13 to 2019-20	67
Table-42	Long-term Growth Trajectory of RPOs, 2019-20 to 2021-22	68

List of Figures

Figure No.	Details	Page No.
Figure-1	Installed Electricity Generation Capacity in India (%), 2008-09 to 2019-20	2
Figure-2	Sector-wise Growth of Installed Electricity Generation Capacity (%), 2008-09 to 2019-20	3
Figure-3	Gross Electricity Generation in India (%), 2008-09 to 2019-20	4
Figure-4	Energy Deficit and Peak Deficit in India, 2008-09 to 2019-20	6
Figure-5	Growth of Transmission System in India, 2008-09 to 2019-20	7
Figure-6	Growth of Electricity Consumption in India (Consumer category-wise), 2008-09 to 2018-19	10
Figure-7	Average Cost of Supply and Average Revenue of State Power Utilities, 2008-09 to 2018-19	11
Figure-8	Volume of Electricity Transacted through Traders and Power Exchanges, 2008-09 to 2019-20	17
Figure-9	Price of Electricity Transacted through Traders and Power Exchanges, 2008-09 to 2019-20	19
Figure-10	Volume and Price of Electricity transacted through DSM	21
Figure-11	Volume of Electricity Transacted Directly between DISCOMs	22
Figure-12	Share of Market Segments in Total Electricity Generation, 2019-20	22
Figure-13	Share of Market Segments in Short-term Transactions, 2019-20	23
Figure-14	Volume of Short-term Transactions of Electricity, 2019-20	24
Figure-15	Share of Electricity Transacted by Traders, 2019-20	26
Figure-16	Concentration of Market Power on the Volume of Electricity transacted through Traders, 2008-09 to 2019-20	27
Figure-17	Comparison of Price of Bilateral, Power Exchange and DSM Transactions in 2019-20	28
Figure-18	Price of Electricity Transacted through Traders during Round the Clock, Peak and Off-peak Periods	29
Figure-19	Volume of Bilateral Transactions at different Price Slabs, 2019-20	30



Figure No.	Details	Page No.
Figure-20	Volume of IEX Transactions at different Price Slabs, 2019-20	30
Figure-21	Volume of PXIL Transactions at different Price Slabs, 2019-20	31
Figure-22	Volume of Short-term Transactions of Electricity, 2019-20	32
Figure-23	Price and its Volatility in IEX during 2019-20	32
Figure-24	Price and its Volatility in PXIL during 2019-20	33
Figure-25	Price and its Volatility in DSM during 2019-20	33
Figure-26	Volume and Price of Electricity Transacted through Traders during RTC, Peak and OTP, 2019-20	34
Figure-27	Block-wise Market Clearing Volume and Price in IEX during 2019-20	35
Figure-28	Block-wise Market Clearing Volume and Price in PXIL during 2019-20	35
Figure-29	Region-wise and Block-wise Price of Electricity Transacted through IEX, 2019-20	36
Figure-30	Region-wise and Block-wise Price of Electricity Transacted through PXIL, 2019-20	36
Figure-31	Trading Margin Charged by Trading Licensees, 2009-10 to 2019-20	38
Figure-32	Sell and Buy Volume of Various Types of Participants in IEX, 2019-20	39
Figure-33	Sell and Buy Volume of Various Types of Participants in PXIL, 2019-20	39
Figure-34	State-wise Number of Open Access Consumers in IEX, March 2020	41
Figure-35	State-wise Number of Open Access Consumers in PXIL, March 2020	41
Figure-36	Energy Scheduled to/from Virtual Ancillary Entity under RRAS (MU), 2019-20	55

Preface

The Electricity Act, 2003 consolidates the laws relating to generation, transmission, distribution, trading and use of electricity and generally for taking measures conducive to development of electricity industry, promoting competition therein, protecting interest of consumers and supply of electricity to all areas, rationalization of electricity tariff, ensuring transparent policies, etc. This is further strengthened by the regulatory initiatives of the Electricity Regulatory Commissions through various regulations and orders required to enable a framework for a robust and healthy power market in the country.

The Central Electricity Regulatory Commission sets the regulatory process in motion through Trading License Regulations, Open Access Regulations, Power Market Regulations, and Deviation Settlement Mechanism Regulations. Under these regulations, short-term power market covers contracts of less than a year for electricity transacted through Inter-State Trading Licensees and directly by the Distribution Licensees, Power Exchanges and Deviation Settlement Mechanism. The short-term power market as an integral part of the power sector has been beneficial for meeting the short-term needs of the consumers, suppliers and the sector as a whole. It constitutes about 10 per cent of the total electricity generation in India in the year 2019-20.

The annual report on short-term power market in India provides a snapshot on the short-term transactions of electricity through different instruments used by various market participants. The Central Electricity Regulatory Commission brings out the report to keep market participants and other stakeholders aware and updated on the state of the power market. Dissemination of information through the report is one of the key elements to ensure efficiency and competition in the sector and for stakeholders and consumers to maintain faith in the system. This report covers overview of power sector, trends in short-term transactions of electricity on annual, monthly and daily basis, time of the day variation in volume and price of electricity, trading margin for bilateral transactions, analysis of transactions carried out by various types of participants with emphasis on open access consumers on power exchanges, effect of congestion on volume of electricity traded on power exchanges and ancillary services operations. The report also covers cross border



trade of electricity between India and its neighbouring countries, tariff of long-term sources of power and analysis on transactions of Renewable Energy Certificates.

In order to ensure ease of access, this report is also made available on the CERC website www.cercind.gov.in. We are confident that market participants and stakeholders will find the Report on Short-term Power Market in India, 2019-20 useful.



Abbreviations

Abbreviation	Expanded Version
AC	Alternating Current
ACE	Area Control Error
AGC	Automatic Generation Control
APL	Above Poverty Line
APCPDCL	Andhra Pradesh Central Power Distribution Company Limited
APDCL	Assam Power Distribution Company Ltd
APPCC	Andhra Pradesh Power Coordination Committee
APSPDCL	Andhra Pradesh Southern Power Distribution Company Limited
APTEL	Appellate Tribunal for Electricity
AT&C	Aggregate Technical and Commercial
Block	15 Minutes Time Block
BSPHCL	Bihar State Power Holding Company Limited
BU	Billion Units (Billion kWh)
CAGR	Compound Annual Growth Rate
CBTE	Cross Border Trade of Electricity
CCGT	Combined Cycle Gas Turbine
CEA	Central Electricity Authority
CERC	Central Electricity Regulatory Commission
CGS	Central Generating Station
CGSEB	Chattisgarh State Electricity Board
Ckm	Circuit km
CPP	Captive Power Producer/Plant
CSPDCL	Chattisgarh State Power Distribution Company Limited
CTU	Central Transmission Utility
DAM	Day Ahead Market
DDUGJY	Deendayal Upadhyaya Gram Jyoti Yojana
DISCOMs	Distribution Companies
DSM	Deviation Settlement Mechanism
DVC	Damodar Valley Corporation
EDCL	Energy development Company Limited
ER	Eastern Region



Abbreviation	Expanded Version
ERSS	Eastern Region Strengthening Scheme
FCAS	Frequency Control Ancillary Services
FGUTPS	Firoz Gandhi Unchahar Thermal Power Station
FRAS	Fast Response Ancillary Services
GOHP/GoHP	Government of Himachal Pradesh
GPS	Gas Power Station
GRIDCO	GRIDCO Limited
GUVNL	Gujarat Urja Vikas Nigam Limited
GW	Giga Watts
HEP	Hydro Electric Project
HHI	Herfindahl-Hirschman Index
HP	Himachal Pradesh
HPP	Hydroelectric Power Plant
HPSEB	Himachal Pradesh State Electricity Board
HVDC	High-Voltage Direct Current
IEGC	Indian Electricity Grid Code
IEX	Indian Energy Exchange
IPDS	Integrated Power Development Scheme
IPP	Independent Power Producers
ISGS	Inter State Generating Station
ISTS	Inter State Transmission System
J&K PDD	Jammu & Kashmir Power Development Department
KV	Kilovolt
kWh	Kilo Watt Hour
LDP	Low Dam Project
LTA	Long Term Access
Ltd	Limited
MCP	Market Clearing Price
MOP	Ministry of Power
MPDCL	Meghalaya Power Distribution Corporation Limited
MPP	Merchant Power Plant
MPPGCL	Madhya Pradesh Power Generating Company Limited
MPPMCL	MP Power Management Company Limited
MU	Million Units



Abbreviation	Expanded Version
MVA	Mega Volt Ampere
MW	Mega Watts
MWh	Mega Watt Hour
NCAS	Network Control Ancillary Services
NCTP	National Capital Thermal Power Plant
NEEPCO	North Eastern Electric Power Corporation Limited
NER	North Eastern Region
NEW Grid	North-East-North East-West Grid
NHDC	National Hydro Development Corporation Limited
NHPC	NHPC Limited
NLC	NLC India Limited
NLDC	National Load Dispatch Centre
NR	Northern Region
NRSS	Northern Region Strengthening Scheme
NSGM	National Smart Grid Mission
NTPC	NTPC Limited
NTPL	NLC Tamil Nadu Power Limited
OA	Open Access
OAC	Open Access Consumer
OTP	Other than RTC and Peak period
OTPC	ONGC Tripura Power Company
PCKL	Power Company of Karnataka Limited
PFC	Power Finance Corporation
PGCIL/POWERGRID	Power Grid Corporation of India Limited
POSOCO	Power System Operation Corporation Limited
PX	Power Exchange
PXIL	Power Exchange India Limited
RE	Renewable Energy
REC	Renewable Energy Certificate
RES	Renewable Energy Sources
RGGVY	Rajiv Gandhi Grameen Vidyutikaran Yojana
RGPS	Ratnagiri Gas Power Station
RLDC	Regional Load Despatch Centre
ROR	Run of River

Abbreviation	Expanded Version
RPC	Regional Power Committee
RPO	Renewable Purchase Obligation
RRAS	Reserves Regulation Ancillary Services
RTC	Round The Clock
S1	Southern Region 1
S2	Southern Region 2
S3	Southern Region 3
SAARC	South Asian Association for Regional Cooperation
SEB	State Electricity Board
SJVNL	Satluj Jal Vidyut Nigam Limited
SRAS	System Restart Ancillary Services
SR Grid	Southern Region Grid
St	Stage
STPP	Super Thermal Power Plant
STPS	Super Thermal Power Station
TAM	Term Ahead Market
TANGEDCO	Tamil Nadu Generation and Distribution Corporation
THDC	Tehri Hydro Development Corporation Limited
TNEB	Tamil Nadu Electricity Board
TPP	Thermal Power Plant
TPS	Thermal Power Station
TSPCC	Telangana State Power Coordination Committee
UDAY	Ujwal DISCOM Assurance Yojana
UPPCL	Uttar Pradesh Power Corporation Limited
VAE	Virtual Ancillary Entity
W1	Western Region 1
W2	Western Region 2
WBSEDCL	West Bengal State Electricity Distribution Company Ltd
WR	Western Region
WRSS	Western Region Strengthening Scheme

Executive Summary

The report comprises overview of power sector, short-term power market in India, cross border trade of electricity, tariff of long-term sources of power and transactions of renewable energy certificates. The overview of power sector highlights electricity generation, transmission and distribution including revenue gap of state electricity distribution companies (DISCOMs)/SEBs and the measures taken by the Government of India in the recent years. Salient features of the power sector are as under:

1. Thermal energy (mainly from Coal) is an important source of electricity generation in India, contributing about 62.4% of the total installed generation capacity in 2019-20, followed by Renewable Energy Source (RES) (23.4%), Hydro (12.3%), and Nuclear (1.8%).
2. The Compound Annual Growth Rate (CAGR) of total installed generation capacity was 9% during the period from 2008-09 to 2019-20. The CAGR in RES was 19% whereas it was 7% in all other sources during the period.
3. During the period from 2008-09 to 2019-20, share of State sector in the total installed generation capacity declined from 54% to 28% and share of central sector has declined from 31% to 25%, while share of private sector increased from 15% to 47%. However, the public sector continues to be the largest owner, holding 53% share in 2019-20.
4. Gross electricity generation in India increased from 747.06 BU in 2008-09 to 1390.93 BU in 2019-20 and it increased annually at the rate of 6%.
5. The annual growth in gross electricity generation was relatively low (6%) when compared with the annual installed electricity generation capacity (9%). This could be mainly due to (i) increase in capacity from RES with low utilization factor; and (ii) decrease in PLF of thermal generation.
6. Increase in the installed capacity resulted in decrease in the demand shortage (energy and peak shortage). The energy shortage decreased from 11.1% in 2008-09 to about 0.5% in 2019-20. During the period, the peak shortage decreased from 11.9% to 0.7%.



7. During 2008-09 to 2019-20, the annual growth in the bulk transmission was 6%, while the annual growth in the transmission capacity of substations was 12%.
8. The annual transmission charges increased at CAGR of 20.66% during the period from 2011-12 to 2019-20.
9. The total electricity consumption increased from 611.29BU in 2008-09 to 1196.31BU in 2018-19 (Estimated) registering an annual growth of 6.9%. During the period, per-capita consumption of electricity also increased from 734 kWh to 1181 kWh at an annual growth of 4.9%.
10. All India average cost of supply and average revenue (without subsidy) of state power utilities increased from ₹3.40/kWh and ₹2.63/kwh, respectively, in 2008-09 to ₹6.09/kWh and ₹4.74/kWh, respectively, in 2018-19. During the latest 5 years, the revenue as percentage of cost was varying between 78% and 81%. This means, the weighted average tariff for all categories of consumers was about 20% lower than the weighted average cost of supply.

‘Short-term transactions of electricity’ refers to contracts of less than one year period for electricity transacted under bilateral transactions through Inter-State Trading Licensees (only inter-State part) and directly by the Distribution Licensees (also referred as Distribution Companies or DISCOMs), Power Exchanges (Indian Energy Exchange Ltd (IEX) and Power Exchange India Ltd (PXIL)), and Deviation Settlement Mechanism (DSM). The analysis of short-term power market includes (i) yearly/monthly/daily trends in short-term transactions of electricity; (ii) time of the day variation in volume and price of electricity transacted through traders and power exchanges; (iii) trading margin charged by trading licensees for bilateral transactions (iv) analysis of open access consumers on power exchanges; (v) major sellers and buyers of electricity in the short term market; (vi) effect of congestion on volume of electricity transacted through power exchanges; and (vii) ancillary services operations. Salient features of the short-term power market are as under:

1. Of the total electricity procured in India in 2019-20, the short-term power market comprised 10%. The balance 90% of generation was procured mainly by distribution companies through long-term contracts and short-term intra-State transactions.



2. During 2009-10 to 2019-20, the volume of short-term transactions of electricity increased at a higher rate (8%) when compared with the gross electricity generation (6%).
3. In terms of volume, the size of the short-term market in India was 137.16BU in the year 2019-20. As compared to the volume of electricity transacted through short-term market in the year 2018-19 (145.20BU), this was about 6% lower.
4. Excluding DSM and direct bilateral sale between the DISCOMs, the volume of electricity transacted was 86.40BU in 2019-20. This was about 14% lower than in 2018-19. In monetary terms, the size of this segment of the short-term market was ₹31,820 crore in the year 2019-20¹, which was 26% less than in the year 2018-19. The decrease in size of the market was mainly due to lower volume transacted through traders and lower electricity prices in power exchanges in 2019-20.
5. The volume of electricity transacted through power exchanges increased at an annual growth rate of 23% whereas the volume of electricity transacted through traders increased at an annual growth rate of 1% during 2009-10 to 2019-20.
6. The volume of DSM in 2019-20 decreased by 10% over 2018-19. The share of DSM as a percentage of total volume of short-term transactions of electricity continued a downward trend in past years and it declined from 39% in 2009-10 to 16% in 2019-20.
7. In terms of volume, the direct bilateral transactions between DISCOMs witnessed an increase of about 46% in 2019-20 as compared to 2018-19. The share of direct bilateral transactions between DISCOMs as a percentage of total short term transaction volume increased from 9% in 2009-10 to 21% in 2019-20. This shows that the DISCOMs are managing the requirement of power on their own instead of relying on the market.
8. The weighted average price of electricity transacted through power exchanges was ₹3.24/kWh and through trading licensees it was ₹4.51/kWh in 2019-20. The corresponding values for the year 2018-19 were ₹4.26/kWh and ₹4.28/kWh,

¹*Excluding transactions pertaining to banking transactions.*



respectively. In the year 2019-20, the weighted average price of electricity transacted through Day Ahead Market sub-segment of the power exchanges was ₹3.16/kWh and that through Term Ahead Market sub-segment was ₹3.77/kWh.

9. The average price of DSM increased from December 2018 onwards as the DSM price vector was linked to daily average Area Clearing Price of power exchanges through CERC Deviation Settlement Mechanism and Related Matters (Fourth Amendment) Regulations, issued in November 2018. These regulations came into force with effect from 1st January 2019. The price of DSM increased from ₹2.68/kWh in 2018-19 to ₹2.85/kWh in 2019-20
10. During 2019-20, about 91% of the volume of electricity transacted through traders was at a price less than ₹6/kWh. About 23% of the volume was transacted at a price less than ₹4/kWh.
11. During 2019-20, IEX transacted 98% of the volume of electricity at a price less than ₹6/kWh while about 87% of the volume was transacted at a price less than ₹4/kWh. During the year, PXIL transacted 100% of the volume of electricity at a price less than ₹5/kWh while about 97% of the volume was transacted at less than ₹4/kWh.
12. During 2019-20, of the total electricity bought under bilateral transactions from traders, 72% was on round the clock (RTC) basis, followed by 25% in periods other than RTC and peak (OTP) and 3% was during peak hours. The per unit price of electricity procured during Peak period was high (₹5.96/kWh) when compared with the price during RTC (₹4.26/kWh) and OTP (₹5.27/kWh).
13. It is observed from the block-wise and region-wise prices of electricity transacted through power exchanges in 2019-20 that the price of electricity in Southern Region was marginally higher than the price in other regions during peak period.
14. During 2008-09 to 2019-20, number of traders who were undertaking trading increased from 14 to 25. HHI, based on volume of electricity transacted in short-term through traders, declined from 0.24 in 2009-10 to 0.16 in 2019-20. The concentration of market

power was moderate during the period. The competition among the traders resulted in an increase in volume and decrease in prices in the short-term bilateral market.

15. The weighted average trading margin charged by the trading licensees in 2019-20 was ₹0.031/kWh, which is in line with the CERC Trading licence Regulations, 2020.
16. The procurement of power by the industrial consumers through power exchanges began in the year 2009. In both power exchanges, Open Access industrial consumers bought 14.46BU of electricity, which formed 29% of the total day ahead volume transacted in the power exchanges during 2019-20.
17. The weighted average price of electricity bought by open access consumers at IEX and PXIL was lower (₹2.84/kWh and ₹3.22/kWh respectively) compared to the weighted average price of total electricity transacted through IEX and PXIL (₹3.16/kWh and ₹3.38/kWh respectively).
18. The year witnessed very few constraints on the volume of electricity transacted through power exchanges, mainly due to transmission congestion. During 2019-20, the actual transacted volume was about 0.40% less than the unconstrained volume. Because of congestion and the splitting of day ahead market at both the power exchanges, the congestion amount collected during the year was ₹55.65 crore.
19. NLDC, in coordination with RLDCs, has started ancillary services operations w.e.f. April 12, 2016. In 2019-20, the NLDC has issued 6367 RRAS Up/Down Instructions on account of various triggering criteria. Of the total, there were 2801 RRAS Up Instructions and 3566 RRAS Down Instructions. Majority of the Regulation Up/Down Instructions were on account of multiple reasons followed by trend of load met and high frequency.
20. The energy scheduled under Regulation UP of RRAS increased from 2212.28MU in 2016-17 to 2435.01MU in 2019-20. The energy scheduled under Regulation DOWN of RRAS increased from 286.00MU in 2016-17 to 1941.31MU in 2019-20.



Salient features of the cross border trade of electricity, tariff of long-term sources of power, and renewable energy certificates transacted through power exchanges are as under:

1. India has been importing electricity from Bhutan and exporting electricity to Bangladesh, Nepal, and Myanmar. India was net importer of electricity from 2013-14 to 2015-16 and net exporter of electricity from 2016-17 to 2019-20. The net export of electricity has been increasing.
2. In 2019-20, the number of Solar RECs transacted on power exchanges were 23.15 lakh and the weighted average market clearing price of these RECs was ₹2293/MWh. During the year, the number of Non-Solar RECs transacted on power exchanges were 64.88 lakh and the weighted average market clearing price of these RECs was ₹1642/MWh.



Chapter-I

Overview of Power Sector

India's power sector is well diversified with market dynamics. Power generation ranges from conventional sources such as coal, lignite, natural gas, oil, hydro and nuclear power to non-conventional sources such as wind, solar, and agricultural and domestic waste. Electricity demand in the country has increased rapidly and is expected to rise further in the years to come. In order to meet the increasing demand for electricity in the country, the electricity supply chain consisting of generation, transmission and distribution has undergone a phase of transformation to competitiveness.

1. Generation


Sources of electricity generation are of two types i.e. conventional and non-conventional. The conventional sources of power generation are thermal (coal, lignite, natural gas and oil), hydro and nuclear power, and non-conventional sources of power generation (renewable energy sources) are wind, solar, agricultural and domestic waste etc. Table-1 and Figure-1 show the installed electricity generation capacity in India by source.

Table-1: Installed Electricity Generation Capacity in India (GW), 2008-09 to 2019-20

Year	Thermal	Hydro	Nuclear	RES	Total
2008-09	93.73	36.88	4.12	13.24	147.97
2009-10	102.45	36.86	4.56	15.52	159.40
2010-11	112.82	37.57	4.78	18.45	173.63
2011-12	131.60	38.99	4.78	24.50	199.88
2012-13	151.53	39.49	4.78	27.54	223.34
2013-14	168.26	40.53	4.78	34.99	248.55
2014-15	188.90	41.27	5.78	38.96	274.90
2015-16	210.68	42.78	5.78	45.92	305.16
2016-17	218.33	44.48	6.78	57.24	326.83
2017-18	222.91	45.29	6.78	69.02	344.00
2018-19	226.28	45.40	6.78	77.64	356.10
2019-20	230.81	45.70	6.78	86.76	370.05

Source: CEA, Growth of Electricity Sector in India, various issues.



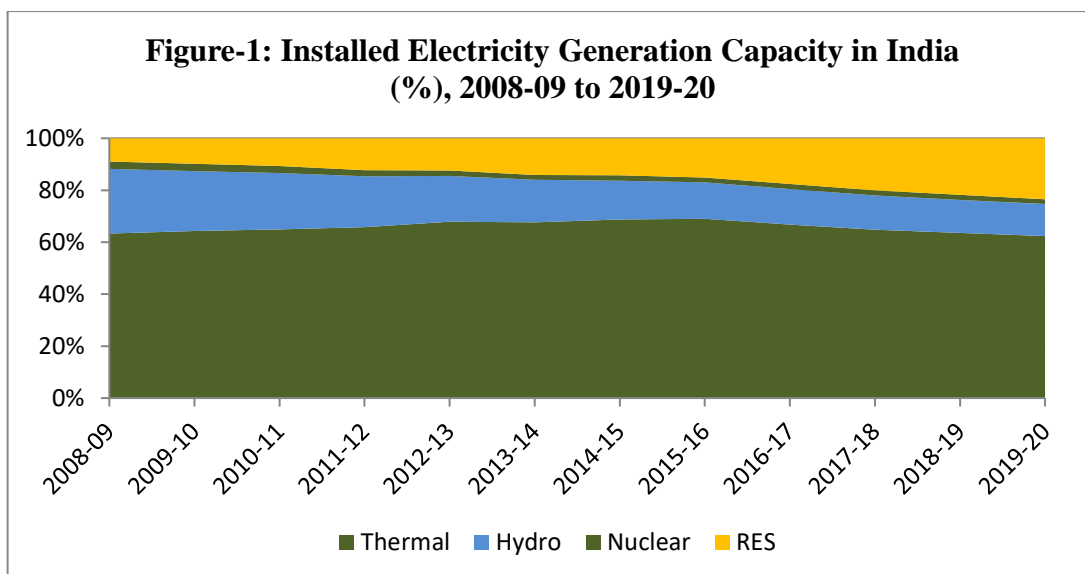

As can be seen in Figure-1, thermal is the most important source of electricity generation in India, contributing about 62.4% of the total capacity of generation in 2019-20, followed by Renewable Energy Source (RES) (23.4%), Hydro (12.3%) and Nuclear (1.8%). The percentage of thermal based generation capacity increased from 63.3% in 2008-09 to 69.0% in 2015-16 and then declined to 62.4% in 2019-20. During the period from 2008-09 to 2019-20, hydro based generation capacity decreased from 24.9% to 12.3%, whereas renewables based generation capacity increased from 8.9% to 23.4%. The CAGR of total installed electricity generation capacity was 9%. The CAGR was 19% in RES where as it was 7% in all other sources.

The Electricity Act of 2003 liberalised the electricity generation through a license-free regime. As a result, the entry of private players into the generation segment significantly increased their share in the total electricity generation.


The players in the electricity generation segment can be divided into three types based on ownership and operations. These are (i) Central public sector undertakings includes NTPC Ltd, NHPC Ltd, NLC India Ltd, and similar entities (ii) State public sector undertakings/State Electricity Boards; and (iii) Private sector enterprises includes Tata Power Company Ltd, Reliance Power Ltd, Adani Power Ltd, and similar entities.

Sector-wise growth of installed generation capacity has been shown in Table-2 and Figure-2. It is observed from the table that CAGR of total installed generation capacity was 9% during the period from 2008-09 to 2019-20. During the period, the share of state sector in the total installed generation capacity has declined from 54% to 28% and the share of central sector has declined from 31% to 25%, whereas the share of private sector has increased more than three fold i.e. from 15% to 47%. However, the public sector continues to be the largest owner, holding 53% share in total installed generation capacity in 2019-20.

Table-2: Sector-wise Growth of Installed Electricity Generation Capacity, 2008-09 to 2019-20

Year	Installed Generation Capacity (GW)			
	State	Central	Private	Total
2008-09	79.31	45.78	22.88	147.97
2009-10	82.91	47.48	29.01	159.40
2010-11	87.42	50.76	35.45	173.63
2011-12	85.92	59.68	54.28	199.88
2012-13	89.13	65.36	68.86	223.34
2013-14	92.27	68.13	84.87	245.26
2014-15	95.08	72.52	104.12	271.72
2015-16	101.79	76.30	124.00	302.09
2016-17	103.97	80.26	142.62	326.85
2017-18	103.97	84.52	155.51	344.00
2018-19	105.08	86.60	164.43	356.10
2019-20	103.53	93.48	173.04	370.05

Source: CEA, Growth of Electricity Sector in India, various issues.

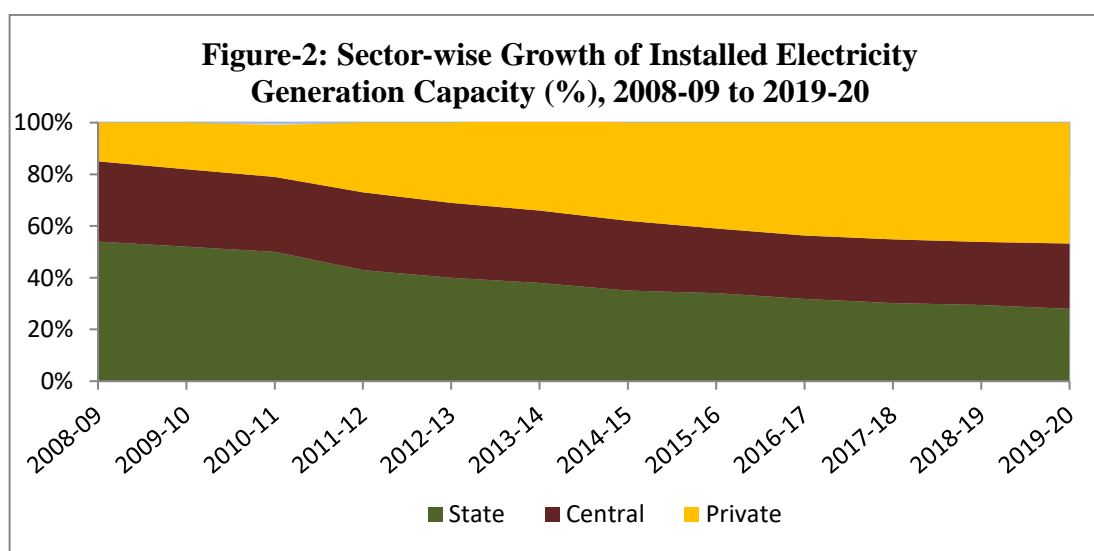


Actual Electricity generation by source is shown in Table-3 and Figure-3. It is observed from the table that gross electricity generation in India has increased from 747.06 BU in 2008-09 to 1390.93 BU in 2019-20. During the period, the gross electricity generation increased at the annual growth rate of 6%. The annual growth in gross electricity generation was low (6%) when compared with the annual installed electricity generation capacity (9%). This may be primarily due to (i) increase in capacity from RES with low utilization factor; and (ii) decrease in PLF of thermal generation.

Table-3: Gross Electricity Generation in India (BU), 2008-09 to 2019-20

Year	Thermal	Hydro	Nuclear	RES	Bhutan Import	Total
2008-09	588.28	110.10	14.93	27.86	5.90	747.06
2009-10	640.21	104.06	18.64	36.95	5.40	805.25
2010-11	665.00	114.30	26.30	41.15	5.60	852.35
2011-12	708.43	130.51	32.29	51.23	5.30	927.75
2012-13	760.45	113.72	32.87	57.45	4.80	969.29
2013-14	792.05	134.85	34.23	59.62	5.60	1026.34
2014-15	877.94	129.24	36.10	61.79	5.00	1110.07
2015-16	943.01	121.38	37.41	65.78	5.20	1172.78
2016-17	994.22	122.31	37.66	81.87	5.64	1241.70
2017-18	1037.06	126.12	38.35	101.84	4.78	1308.15
2018-19	1072.00	135.00	37.70	126.76	4.40	1375.86
2019-20	1044.45	155.97	46.38	138.32	5.81	1390.93

Source: CEA, Growth of Electricity Sector in India, various issues.

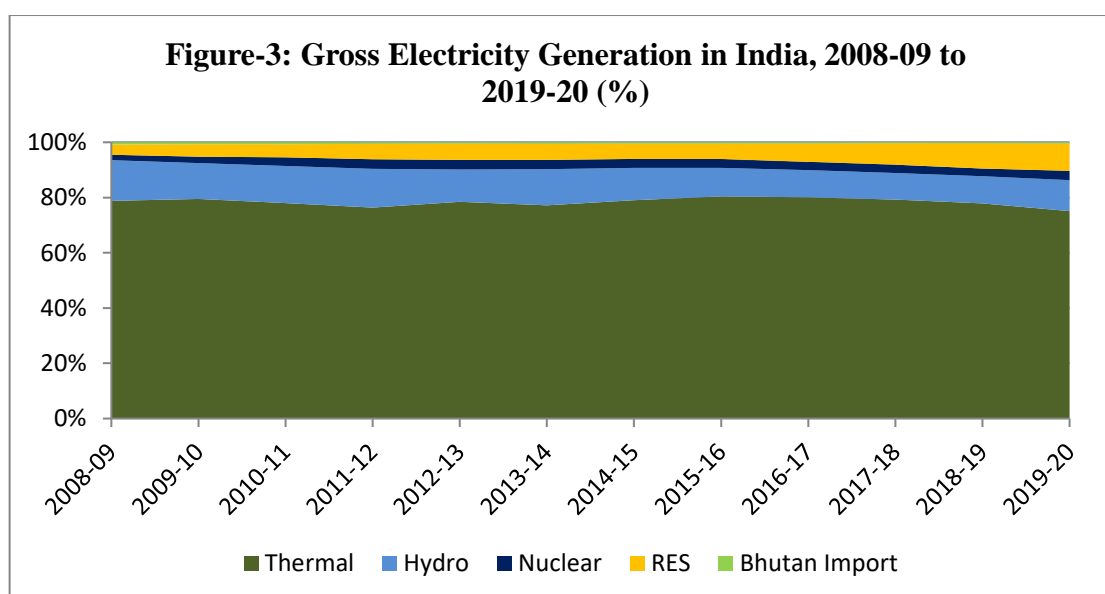

Of all the sources, electricity generation from thermal source (mainly coal) plays a dominant role in India. The electricity generated from thermal was varying between 75% to 80% of the total generation during 2008-09 to 2019-20. The amount of electricity generated through hydro declined from 15% to 11% whereas the electricity generated from RES increased from 4% to 10%, during the period.


As shown in the above tables, the total installed electricity generation capacity in India has increased from 147.97 GW in 2008-09 to 370.05 GW in 2019-20. The increase in installed electricity generation capacity made an impact on the power supply position as shown in Table-4 and Figure-4. Both energy requirement and peak demand increased from 777.04 BU and 109.81 GW, respectively in 2008-09 to 1290.25 BU and 183.80 GW, respectively in 2019-20. Increase in the installed capacity resulted in decrease in the shortage (energy and peak shortage). The energy and peak shortages declined from 11.1% and 11.9%, respectively in 2008-09 to about 0.5% and 0.7%, respectively in 2019-20.

Table-4: Power Supply Position in India, 2008-09 to 2019-20

Year	Energy (BU)			Peak (GW)		
	Requirement	Availability	Deficit (%)	Peak Demand	Peak Met	Deficit (%)
2008-09	777.04	691.04	11.1%	109.81	96.79	11.9%
2009-10	830.59	746.64	10.1%	119.17	104.01	12.7%
2010-11	861.59	788.36	8.5%	122.29	110.26	9.8%
2011-12	937.20	857.89	8.5%	130.01	116.19	10.6%
2012-13	995.56	908.65	8.7%	135.45	123.29	9.0%
2013-14	1002.26	959.83	4.2%	135.92	129.82	4.5%
2014-15	1068.92	1030.79	3.6%	148.17	141.16	4.7%
2015-16	1114.41	1090.85	2.1%	153.37	148.46	3.2%
2016-17	1142.93	1135.33	0.7%	159.54	156.93	1.6%
2017-18	1212.13	1203.57	0.7%	164.07	160.75	2.0%
2018-19	1274.60	1267.53	0.6%	177.02	175.53	0.8%
2019-20	1290.25	1283.69	0.5%	183.80	182.53	0.7%

Source: Ministry of Power



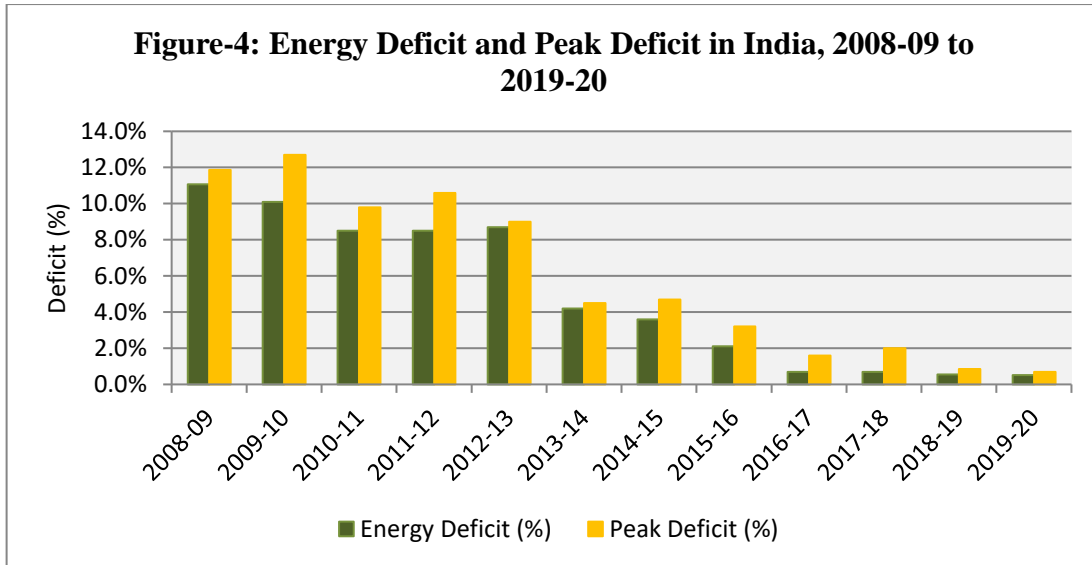

Electricity demand is defined in the narrowest sense because it is counted as the amount of electricity that distribution utilities buy, but not the actual demand of the millions of people in India who remain unserved or under served.

2. Transmission

The transmission sector was opened for private investments in 1998. The Central Transmission Utility (CTU) is the nodal agency for providing the medium-term (3 months to 5 years) and long-term (exceeding 7 years) access (the right to use the inter-state transmission system) typically required by a generating station or a trader acting on the station’s behalf. The PGCIL is responsible for inter-state transmission and development of the national grid, and it acts as the CTU. The RLDCs are the nodal agencies for grant of short-term open access (upto 3 months). The nodal agency providing transmission access to the power exchanges is the NLDC.

Open Access refers to the right to generators of electricity [Captive Power Plants² (CPP)/Independent Power Producers (IPP)] and bulk consumers³ to sell the generated electricity at a certain transmission surcharge and to access the transmission and distribution networks of any generator without any discrimination by the

² *Captive Power refers to generation from a unit set up by industry for its own consumption*

³ *Bulk consumers are consumers with power requirement of 1MW or above*


distribution/transmission line owners. The principle of open access is based on the premise that while it is uneconomical to lay down multiple transmission lines in the same region because of the large sunk costs involved, it is still best to give consumers a choice to decide which firm's electricity they want to consume.

The growth of transmission system (transmission lines and transformation capacity) in India during 2008-09 to 2019-20 has been shown in Table-5 and Figure-5.

Table-5: Growth of Transmission System in India, 2008-09 to 2019-20

Year	Transmission Lines (AC+HVDC) (ckm)	Transformation Capacity of Substations (220KV and above) (MVA)
2008-09	220794	288615
2009-10	236467	310052
2010-11	254536	345513
2011-12	257481	409551
2012-13	274588	473216
2013-14	291336	530546
2014-15	313437	596100
2015-16	341551	658949
2016-17	367851	740765
2017-18	390970	826958
2018-19	413407	899663
2019-20	425071	967893

Source: CEA, Monthly Reports.

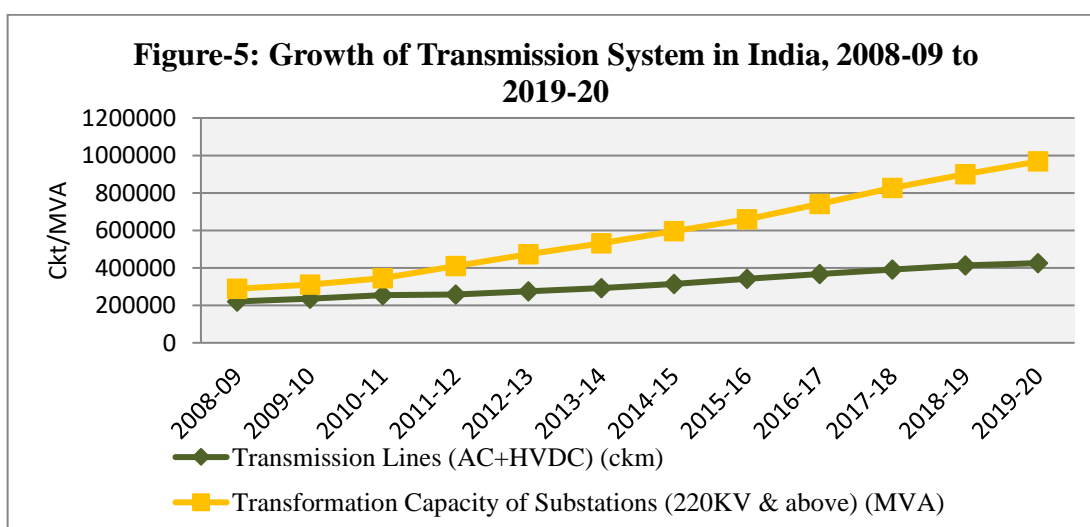

It is observed from the Table-5 that bulk transmission (transmission lines 220kv & above) has increased from 2.20 lakh ckm in 2008-09 to 4.25 lakh ckm in 2019-20. During the period, the transformation capacity of substations has also increased from 2.88 lakh MVA to 9.67 lakh MVA. The CAGR in the transmission lines and transformation capacity of substations was 6% and 12% respectively.

Table-6 provides the data on annual transmission charges (transmission charges applicable for transmission lines owned by PGCIL and other ISTS licensees) for the period from 2011-12 to 2019-20. The annual transmission charges increased at CAGR of 20.66% during the period. There are various reasons for increase in the transmission charges. Main reasons like the growth of transmission lines (especially at higher voltage levels), waiver of transmission charges for interstate renewable energy generators and relinquishment of long term access (LTA) have lead to increase in the annual transmission charges.

Table-6: Annual Transmission Charges, 2011-12 to 2019-20

Year	Transmission Charges as on 31st March (₹ Crore)
2011-12	8743
2012-13	12797
2013-14	15118
2014-15	17680
2015-16	22476
2016-17	27383
2017-18	31405
2018-19	35599
2019-20	39285

Source: POSOCO

The transmission sector is having natural monopoly as there are high sunk costs in investing in the infrastructure needed to transmit electricity, such as transmission lines. Because of these characteristics, non-public entities also face entry barriers, and private investments are allowed in transmission projects only after approval from CERC. Although the transmission market is largely dominated by the public sector, there are many lines including High-Voltage Direct Current (HVDC) lines owned by private players. There are about 63 Inter-state transmission licensees as on 31.3.2020 granted by CERC (Annexure-I).

3. Distribution

State Electricity Distribution Companies (DISCOMs)/State Electricity Boards (SEBs) own the majority of the distribution segment in the electricity supply chain. In order to boost competition and make the sector more efficient, the Government is emphasizing the importance of a well-performing distribution sector and has been focusing on the improvement of the financial health of utilities. This is necessary to meet the goal of providing people a reliable and good-quality power and universal access to electricity. To meet this goal, it is required to increase rural electrification, reduce aggregate technical and commercial (AT&C) losses incurred while distributing electricity, ensure the financial viability of DISCOMs, and encourage private sector participation.

The growth in electricity consumption (consumer category-wise) is provided in Table-7 & Figure-6. The total electricity consumption increased from 611.29 BU in 2008-09 to 1196.31 BU in 2018-19 (Estimated) at an annual growth rate of 6.9%. During the period, per capita consumption of electricity in India has increased from 734 kWh to 1181 kWh, registering an annual growth rate of 4.9%. Despite this considerable growth, the level of per capita energy consumption in India is low when compared to the international average per capita energy consumption.


**Table-7: Growth of Electricity Consumption in India
(Consumer category-wise) (BU), 2008-09 To 2018-19**

Year	Domes- tic	Commer- cial	Indus- trial	Agri- culture	Traction	Misc.	Total
2008-09	130.06	53.54	279.66	107.78	11.81	28.45	611.29
2009-10	144.25	59.30	290.26	119.32	12.41	27.71	653.24
2010-11	156.02	68.72	301.26	123.39	13.09	29.93	692.40
2011-12	171.10	65.38	352.29	140.96	14.21	41.25	785.19
2012-13	183.70	72.79	365.99	147.46	14.10	40.26	824.30
2013-14	199.84	74.25	384.42	152.74	15.54	47.42	874.21
2014-15	217.41	78.39	418.35	168.91	16.18	49.29	948.52
2015-16	238.88	86.04	423.52	173.19	16.59	62.98	1001.19
2016-17	255.83	89.83	440.21	191.15	15.68	68.49	1061.18
2017-18	273.55	93.76	468.61	199.25	17.43	70.83	1123.43
2018-19*	296.22	98.62	492.36	211.61	18.19	79.31	1196.31

* Estimated

Source: CEA, *Growth of Electricity Sector in India, various issues.*



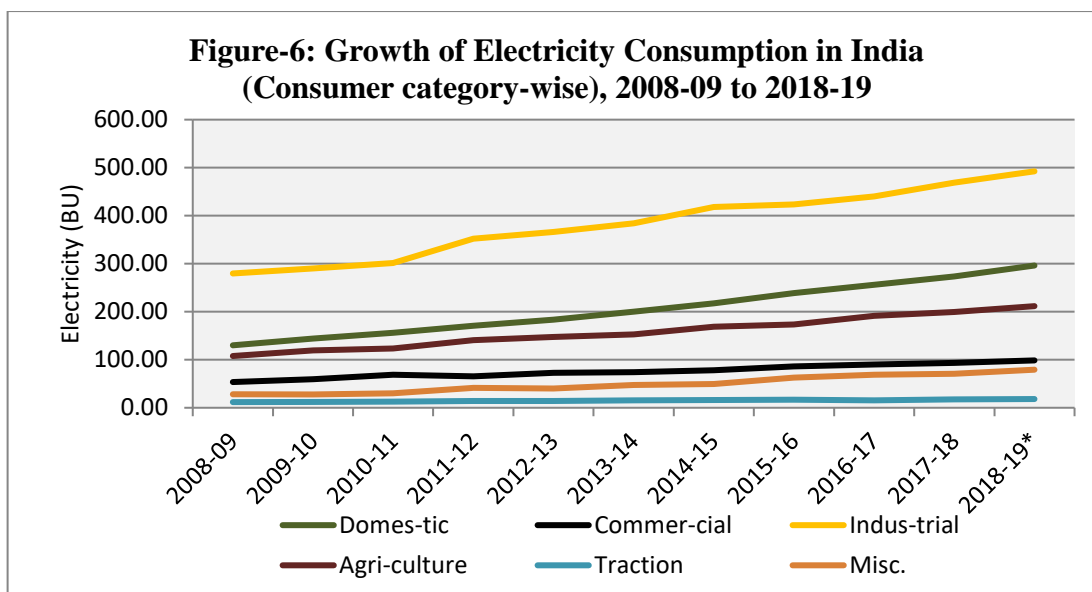

The AT&C Losses declined from 27.34% in 2008-09 to 22.01% in 2018-19. More than 90% of these losses can be attributed to Transmission and Distribution Losses which correspond to electricity produced but not paid for. These losses should be reduced to the international standard of 10%.


The electricity tariffs charged by the DISCOMs are not cost reflective. The DISCOMs sell electricity below cost or provide electricity at free/subsidized rates for agriculture and domestic consumers. The tariffs for residential and agricultural consumers are subsidized by overcharging industrial and commercial users. Average cost of supply and average revenue of all state power utilities has been provided for the period from 2008-09 to 2018-19 in Table-8 and Figure-7.

All India average cost of supply and average revenue (without subsidy) increased from ₹3.40/kWh and ₹2.63/kwh, respectively, in 2008-09 to ₹6.09/kWh and ₹4.74/kWh, respectively, in 2018-19. Here the average revenue includes revenue from operations, regulatory income, revenue grants under UDAY and other income and revenue grants. However the gap between the cost of supply and revenue has increased during the period. During the latest 5 years i.e. from 2014-15 to 2018-19, the revenue as percentage of cost of supply was varying between 78% to 81%. This means, the average revenue was about 20% lower than the average cost of supply. This gap is financed through budgetary support as subsidy by the Government.

Table-8: Average Cost of Supply and Average Revenue of State Power Utilities, 2008-09 to 2018-19

Year	Average Cost of Supply (₹/kWh)	Average Revenue (without subsidy) (₹/kWh)	Revenue Gap (₹/kWh)	Revenue as % of Cost
2008-09	3.40	2.63	0.77	77%
2009-10	3.55	2.68	0.87	75%
2010-11	3.98	3.03	0.95	76%
2011-12	4.55	3.30	1.25	73%
2012-13	5.03	3.76	1.27	75%
2013-14	5.19	4.00	1.19	77%
2014-15	5.21	4.15	1.06	80%
2015-16	5.43	4.23	1.20	78%
2016-17	5.48	4.36	1.12	80%
2017-18	5.60	4.51	1.09	81%
2018-19	6.09	4.74	1.35	78%

Source: PFC, Report on The Performance of State Power Utilities.

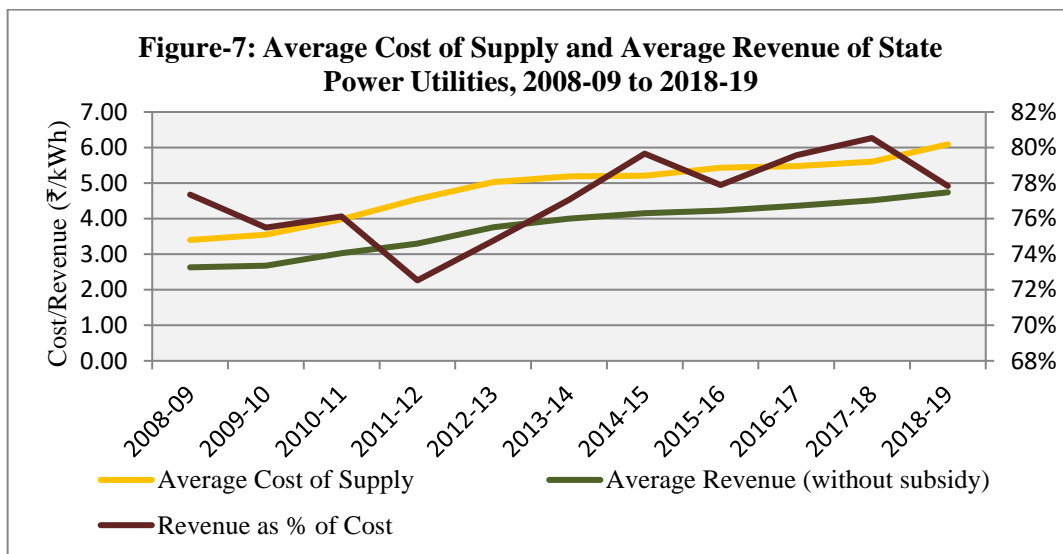

The DISCOMs in the country are trapped in a vicious cycle with huge operational losses and outstanding debt due to legacy issues. Financially stressed DISCOMs are not able to supply adequate power at affordable rates. To improve their financial health, several policy initiatives have been taken by the Union Government during last few years like Ujwal DISCOM Assurance Yojana (UDAY, launched in 2015), Integrated Power Development Scheme (IPDS, launched in 2014), National Smart Grid Mission (NSGM), etc. UDAY is being implemented in various states for the

financial turnaround and revival of the DISCOMs through four initiatives (i) improving operational efficiencies of DISCOMS; (ii) reduction of cost of power purchase; (iii) reduction in interest cost of DISCOMs; (iv) enforcing financial discipline on DISCOMs through alignment with State finances.

The IPDS works with the objectives of reducing AT&C losses, establishment of IT enabled energy accounting/auditing system, improvement in billed energy based on metered consumption and improvement in collection efficiency and the scheme is focused on urban areas. The Deen Dayal Upadhyaya Gram Jyoti Yojana (DDUGJY, launched in 2014) is centred on improving distribution and electrification in rural areas. The scheme includes the Rajiv Gandhi Grameen Vidyutikaran Yojana (RGGVY) as a key component of the rural electrification initiative.

The Pradhan Mantri Sahaj Bijli Har Ghar Yojana (Saubhagya Scheme) was launched in September 2017, to provide free electricity connections to all households, for above poverty line (APL) & poor families in rural areas and poor families in urban areas. All DISCOMs including Private Sector DISCOMs, State Power Departments and Renewable Energy Cooperative Societies shall be eligible for financial assistance under the scheme in line with DDUGJY.

The implementation of the above mentioned programmes has led to considerable improvements in the distribution segment. However, the achievements have remained much below the targets. AT&C losses have come down to about 22.01 per cent in 2018-19 as per the Report on Performance of State Power Utilities, 2018-19 published by Power Finance Corporation Ltd, which is still higher than the 15 per cent target. The schemes have also received a push from the UDAY which has set strict loss reduction targets for discoms.

Chapter-II

Short-term Power Market in India

1. Introduction

Prior to the Electricity Act 2003, the electricity industry recognized generation, transmission and supply as three principal activities, and the legal provisions were also woven around these concepts. With the enactment of the Electricity Act, the transaction involving purchase and sale of electricity has been recognized as a distinct licensed activity. Recognition of trading as a separate activity is in sync with the overall framework of encouraging competition in all segments of the electricity industry. The Electricity Act 2003 laid down provisions for promoting competition in the Indian power market. Introduction of non-discriminatory open access in electricity sector provided further impetus for enhancing competition in the market. The responsibility of developing the market in electricity has been vested with the Regulatory Commissions. The open access regulations, inter-state trading regulations, power market regulations etc., of the Central Commission have facilitated power trading in an organized manner.

Bulk electric power supply in India is mainly tied in long-term contracts. The DISCOMs who have the obligation to provide electricity to their consumers mainly rely on supplies from these long-term contracts. Nevertheless, to meet the short-term requirements of the market participants, short term trading plays an important role in the power market.

A brief analysis of the short-term transactions of electricity in India has been done in this Report⁴ for the year 2019-20. Here, “short-term transactions of electricity” refers to the contracts less than one year for the following trades:

⁴*Although Deviation Settlement Mechanism (DSM) is not a market mechanism, electricity transacted under DSM is often considered a part of short-term transaction. Also, electricity transacted bilaterally directly between the distribution companies (without involving trading licensees or power exchanges) is also considered a part of short-term market. In the year 2019-20, the volume of DSM was about 22.59BU and that between distribution companies was about 28.17BU.*



- (a) Electricity traded under bilateral transactions through Inter-State Trading Licensees (only inter-state trades),
- (b) Electricity traded directly by the Distribution Licensees (also referred as Distribution Companies or DISCOMs),
- (c) Electricity traded through Power Exchanges (Indian Energy Exchange Ltd (IEX) and Power Exchange India Ltd (PXIL)), and
- (d) Electricity transacted through Deviation Settlement Mechanism(DSM).

The analysis includes:

- (i) Yearly/monthly/daily trends in short-term transactions of electricity;
- (ii) Time of the day variation in volume and price of electricity transacted through traders and power exchanges;
- (iii) Trading margin charged by trading licensees for bilateral transactions;
- (iv) Analysis of open access consumers on power exchanges;
- (v) Major sellers and buyers of electricity in the short term market;
- (vi) Effect of congestion on volume of electricity transacted through power exchanges; and
- (vii) Ancillary services operations

2. Yearly Trends in Short-term Transactions of Electricity (2008-09 to 2019-20)

The analysis on yearly trends in short-term transactions includes the electricity transacted through the following segments:

- trading licensees (inter-state part only) under bilateral transactions or “bilateral trader” segment ,
- power exchange segment with transactions in both Day Ahead and Term Ahead Markets,
- DSM segment, and
- Direct transactions of electricity between DISCOMs.

Inter-state trading licensees (traders) have been undertaking trading in electricity since 2004 and the power exchanges started operating since 2008. The two power



exchanges, IEX and PXIL started their operations in June 2008 and October 2008 respectively. As of March 2020, there were 34 inter-state trading licensees (list is enclosed at Annexure-II) and two power exchanges.

2.1 Total Short-term Transactions of Electricity with respect to Total Electricity Generation

Total volume of short-term transactions of electricity increased from 65.90BU in 2009-10 to 137.16BU in 2019-20. During the period, the volume of short-term transactions of electricity increased at a higher rate (annual growth rate of 8%) when compared with the total electricity generation⁵ (annual growth rate of 6%). The volume of short-term transactions of electricity as percentage of total electricity generation varied from 8% to 11% during the period (Table-9).

Table-9: Volume of Short-term Transactions of Electricity with respect to Total Electricity Generation, 2009-10 to 2019-20

Year	Volume of Short-term Transactions of Electricity (BU)	Total Electricity Generation (BU)	Volume of Short-term Transactions of Electricity as % of Total Electricity Generation
2009-10	65.90	805.25	8%
2010-11	81.56	852.35	10%
2011-12	94.51	927.75	10%
2012-13	98.94	969.29	10%
2013-14	104.64	1026.34	10%
2014-15	98.99	1110.07	9%
2015-16	115.23	1172.78	10%
2016-17	119.23	1241.70	10%
2017-18	127.62	1308.15	10%
2018-19	145.20	1375.86	11%
2019-20	137.16	1390.93	10%

Source: NLDC & CEA

⁵ Total electricity generation is the gross electricity generation in India as defined by CEA.

The analysis of yearly trends of short-term transactions of electricity for various segments, i.e. electricity transacted through traders and power exchanges, DSM, and directly between DISCOMs is included in the sections that follow.

2.1.1 Electricity Transacted through Traders and Power Exchanges


Table-10, Table-11 and Figure-8 show details of volume of electricity transacted through traders under bilateral transactions and through power exchanges for the period from 2008-09 to 2019-20. The volume of electricity transacted through traders and power exchanges increased from 24.69BU in 2008-09 to 86.40BU in 2019-20. The share of electricity transacted through traders and power exchanges as a percentage of total short-term transactions of electricity increased from 51.45% in 2009-10 to 62.99% in 2019-20. The CAGR in volume of this segment during 2009-10 to 2019-20 was 12%.

Table-10: Volume of Electricity Transacted through Traders and Power Exchanges, 2008-09 to 2019-20

Year	Electricity Transacted through Traders (BUs)	Electricity Transacted through IEX (BUs)		Electricity Transacted through PXIL (BUs)		Electricity Transacted through IEX and PXIL (BUs)	Total (BUs)
		Day Ahead Market	Term Ahead Market	Day Ahead Market	Term Ahead Market		
2008-09	21.92	2.62		0.15		2.77	24.69
2009-10	26.72	6.17	0.10	0.92	0.003	7.19	33.91
2010-11	27.70	11.80	0.91	1.74	1.07	15.52	43.22
2011-12	35.84	13.79	0.62	1.03	0.11	15.54	51.38
2012-13	36.12	22.35	0.48	0.68	0.04	23.54	59.66
2013-14	35.11	28.92	0.34	1.11	0.30	30.67	65.78
2014-15	34.56	28.12	0.22	0.34	0.72	29.40	63.96
2015-16	35.43	33.96	0.33	0.14	0.58	35.01	70.43
2016-17	33.51	39.78	0.74	0.25	0.35	41.12	74.63
2017-18	38.94	44.84	1.37	0.73	0.75	47.70	86.64
2018-19	47.32	50.06	2.10	0.09	1.26	53.52	100.84
2019-20	29.95	49.11	4.77	0.05	2.52	56.45	86.40

Note1: The volume of electricity transacted through traders in 2008-09 (April to July 2008) includes cross border trading and intra-state trading volume.



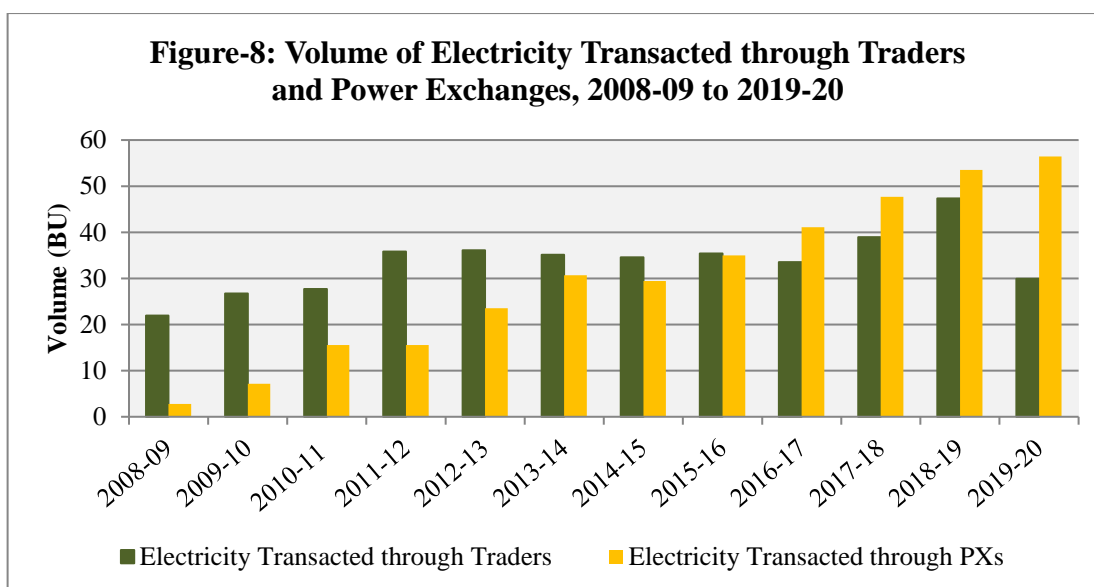

A comparison between the volume of electricity transacted through traders and power exchanges has been shown in Figure-8. It is observed from the figure that the volume of electricity transacted through traders was relatively high when compared with the volume of electricity transacted through power exchanges during 2008-09 to 2015-16. During the latest four years, i.e. in 2016-17 and 2019-20, the volume of electricity transacted through power exchanges was relatively high when compared with the volume of electricity transacted through traders. This shows that there was more demand for electricity through DAM of power exchanges than the bilateral transactions through traders. The volume of electricity transacted through power exchanges increased at an annual growth rate of 32% whereas the volume of electricity transacted through traders grew at 3% during 2009-10 to 2019-20.

Table-11: Electricity Transacted through Traders and Power Exchanges as percentage of Total Short-term Transactions, 2009-10 to 2019-20


Year	Volume of Electricity Transacted through Traders & Power Exchanges (BUs)	Total Short-term Transactions of Electricity (BUs)	Electricity Transacted through traders & PXs as % to Total Volume of Short-term
2009-10	33.91	65.90	51.45%
2010-11	43.22	81.56	53.00%
2011-12	51.38	94.51	54.37%
2012-13	59.66	98.94	60.30%
2013-14	65.78	104.64	62.87%

2014-15	63.96	98.99	64.62%
2015-16	70.43	115.23	61.12%
2016-17	74.63	119.23	62.60%
2017-18	86.64	127.62	67.89%
2018-19	100.84	145.20	69.45%
2019-20	86.40	137.16	62.99%

The prices of electricity transacted through traders and Power Exchanges are shown in Table-12 and Figure-9. The weighted average price of electricity transacted through traders and power exchanges declined from ₹7.29/kWh and ₹7.49/kWh respectively in 2008-09 to ₹4.51/kWh and ₹3.24/kWh respectively in 2019-20. Except in 2008-09, the price of electricity transacted through traders was relatively high when compared with the price of electricity transacted through power exchanges. This could be for various reasons, mainly the delivery of electricity through traders is mostly at state periphery whereas in case of power exchanges the delivery of electricity is at regional periphery. The electricity contracts in case of bilateral transactions take place well in advance (i.e. weekly/monthly upto one year) whereas the electricity contract in case of DAM of power exchanges is one day before. Therefore, the nature and duration of contract influence the price of electricity.

Table-12: Price of Electricity Transacted through Traders & Power Exchanges, 2008-09 to 2019-20

Year	Price of Electricity transacted through Traders (₹/kWh)	Price of Electricity transacted through Power Exchanges (DAM+TAM) (₹/kWh)
2008-09	7.29	7.49
2009-10	5.26	4.96
2010-11	4.79	3.47
2011-12	4.18	3.57
2012-13	4.33	3.67
2013-14	4.29	2.90
2014-15	4.28	3.50
2015-16	4.11	2.72
2016-17	3.53	2.50
2017-18	3.59	3.45
2018-19	4.28	4.26
2019-20	4.51	3.24

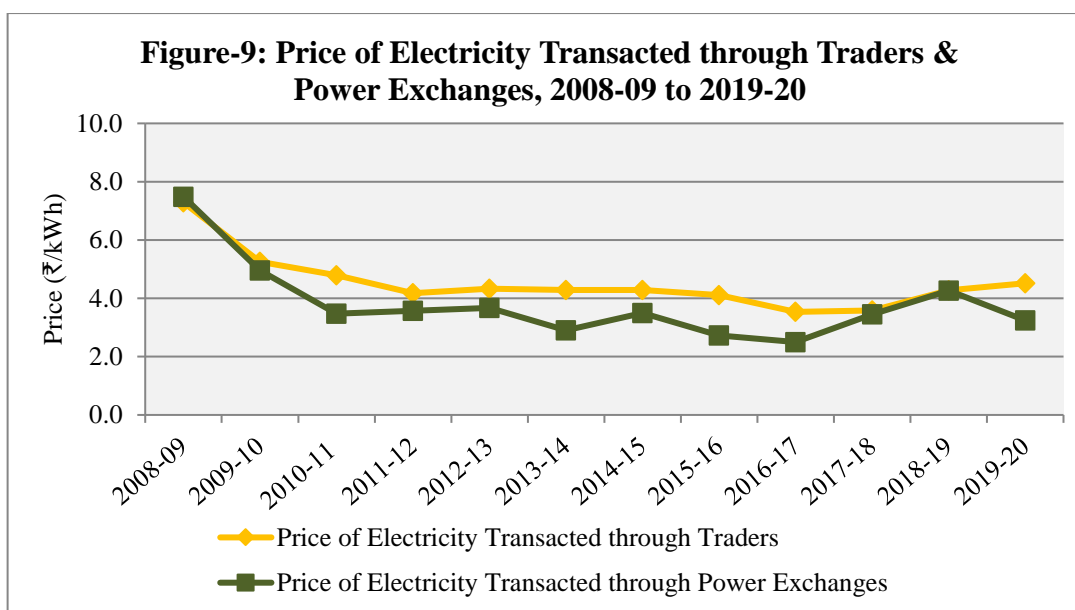

The size of the bilateral and power exchange market increased from ₹17,617 Crore in 2009-10 to ₹31,820 Crore in 2019-20 and the size of this market increased at an annual growth rate of 6% (Table-13). Variation in volume and price affected the size of bilateral and power exchange market. During 2009-10 to 2019-20, the volume of electricity transacted through bilateral and power exchange registered a positive growth of 1% and 23% respectively, while the price of electricity transacted through both bilateral and power exchange registered a negative growth of -2% and -4% respectively. During 2019-20, due to variation in volume and price, the size of bilateral and power exchange market declined by 26% over the previous year.

Table-13: Size of Short-term Power Market (Bilateral and Power Exchange)

Year	Electricity Transacted through trading Licensees (BU)	Price of Electricity Transacted through Trading licensees (₹/kWh)	Size of bilateral trader Market in ₹ Crore	Electricity Transacted through Power Exchanges (BU)	Price of Electricity Transacted through Power Exchanges (₹/kWh)	Size of Power Exchange Market in ₹ Crore	Total Size of the bilateral trader + Power Exchange Market (₹ Crore)
2009-10	26.72	5.26	14055	7.19	4.96	3563	17617
2010-11	27.70	4.79	13268	15.52	3.47	5389	18657
2011-12	35.84	4.18	14979	15.54	3.57	5553	20532
2012-13	36.12	4.33	15624	23.54	3.67	8648	24272
2013-14	35.11	4.29	15061	30.67	2.90	8891	23952
2014-15	34.56	4.28	14801	29.40	3.50	10288	25089


2015-16	35.43	4.11	14557	35.01	2.72	9539	24096
2016-17	33.51	3.53	11844	41.12	2.50	10280	22124
2017-18	38.94	3.59	13970	47.70	3.45	16457	30427
2018-19	47.32	4.28	20255	53.52	4.26	22809	43064
2019-20	29.95	4.51	13516	56.45	3.24	18303	31820

2.1.2 Electricity Transacted through DSM

The volume and price of electricity transacted through DSM is shown in Table-14 and Figure-10. It can be observed from the table that there was a declining trend in the volume of electricity transacted through DSM from 2010-11 to 2014-15 and there was an increasing trend from 2014-15 to 2018-19. However, the volume of DSM as percentage of total short-term volume declined to 16% in 2019-20 from 39% in 2009-10. It can also be observed from the table that the average price of DSM declined from ₹4.62/kWh in 2009-10 to ₹2.85/kWh in 2019-20. This was mainly due to changes in DSM regulations issued by CERC from time to time. Since the DSM is not a market mechanism, the decline in DSM volume is good for the market. As far as the electricity market is concerned, the volume in this segment of the short-term should be as minimal as possible. Price of DSM plays an important role in ensuring system balance and secure reliable grid operation.

Table-14: Volume and Price of Electricity transacted through DSM

Year	Volume of Electricity Transacted through DSM (BU)	Total Volume of Short term (BU)	Volume of DSM as % of total volume of Short term	Price of Electricity Transacted through DSM (₹/kWh)
2009-10	25.81	65.90	39%	4.62
2010-11	28.08	81.56	34%	3.91
2011-12	27.76	94.51	29%	4.09
2012-13	24.76	98.94	25%	3.86
2013-14	21.47	104.64	21%	2.05
2014-15	19.45	98.99	20%	2.26
2015-16	20.75	115.23	18%	1.93
2016-17	23.22	119.23	19%	1.76
2017-18	24.21	127.62	19%	2.03
2018-19	25.13	145.20	17%	2.68
2019-20	22.59	137.16	16%	2.85

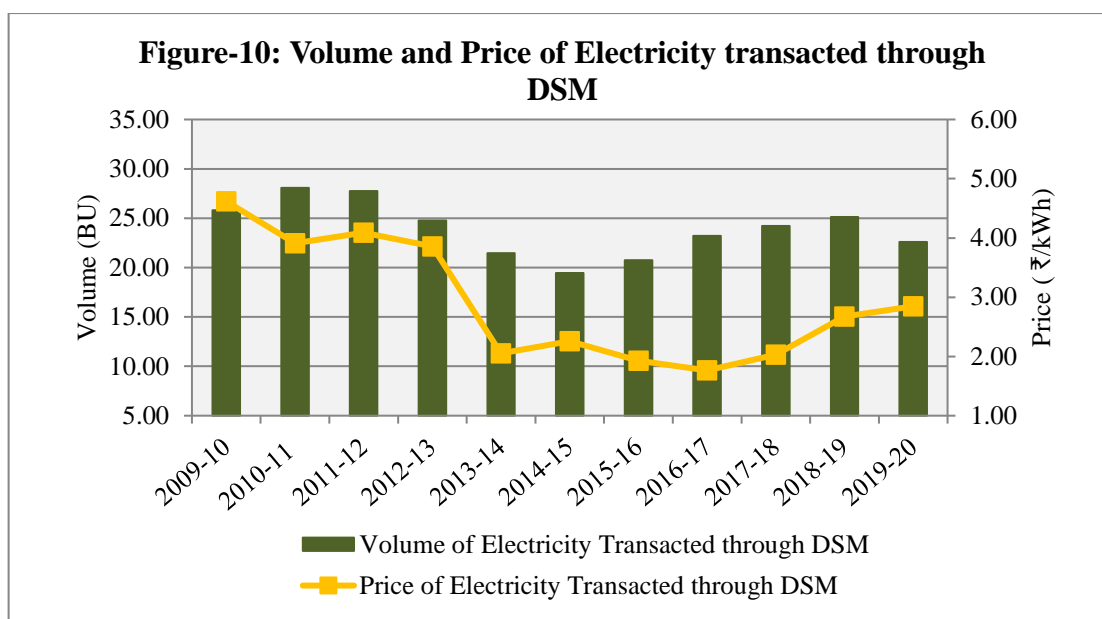


2.1.3 Electricity Transacted Directly Between DISCOMs

The volume of electricity transacted directly between DISCOMs is shown in Table-15 and Figure-11. It can be observed from the table that the volume of electricity transacted directly between DISCOMs increased from 6.19 BU in 2009-10 to 28.17 BU in 2019-20. It can also be observed that the volume of electricity transacted directly between DISCOMs as percentage to total volume of short-term transactions of electricity increased from 9% to 21% during the period.

Table-15: Volume of Electricity Transacted Directly between DISCOMs


Year	Volume of Electricity Transacted Directly between DISCOMs (BU)	Total Volume of Short term (BU)	Volume of Bilateral Direct as % of total volume of Short term
2009-10	6.19	65.9	9%
2010-11	10.25	81.56	13%
2011-12	15.37	94.51	16%
2012-13	14.52	98.94	15%
2013-14	17.38	104.64	15%
2014-15	15.58	98.99	16%
2015-16	24.04	115.23	21%
2016-17	21.38	119.23	18%
2017-18	16.77	127.62	13%
2018-19	19.23	145.20	13%
2019-20	28.17	137.16	21%

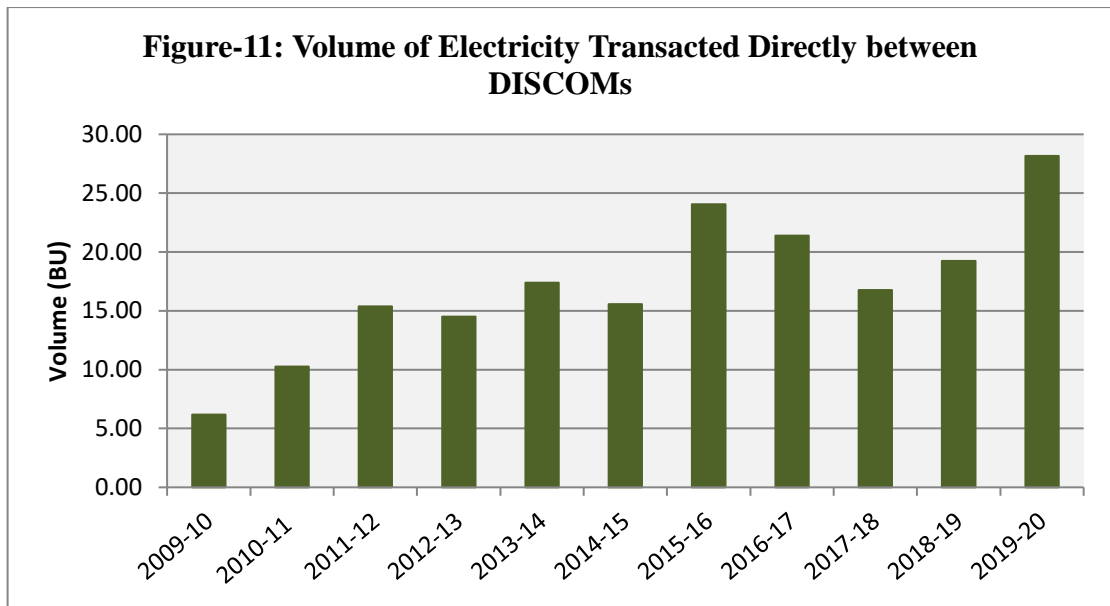


The increasing trend in the volume of electricity transacted directly by DISCOMs shows that the DISCOMs are independently managing the volume of electricity that they require to buy/sell instead of relying on traders and power exchanges.

3. Monthly Trends in Short-term Transactions of Electricity (April 2019-March 2020)

During 2019-20, the share of total short-term transactions in volume terms, including DSM, as a percentage of total electricity generation in the country was about 11% (Figure-12 and Table-16).

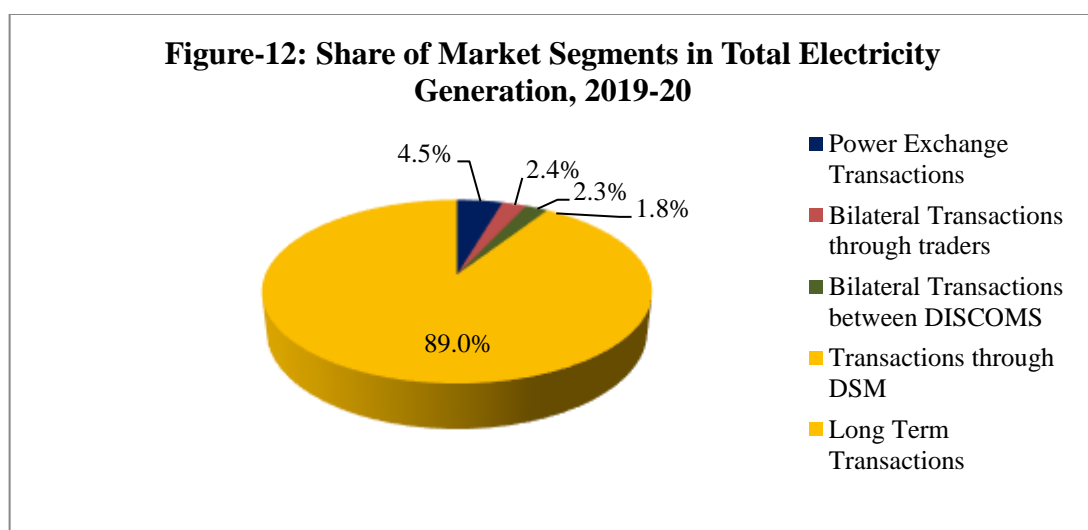

The share of different market segments within the total short-term transaction for the year 2019-20 has been shown in the Figure-13 below.

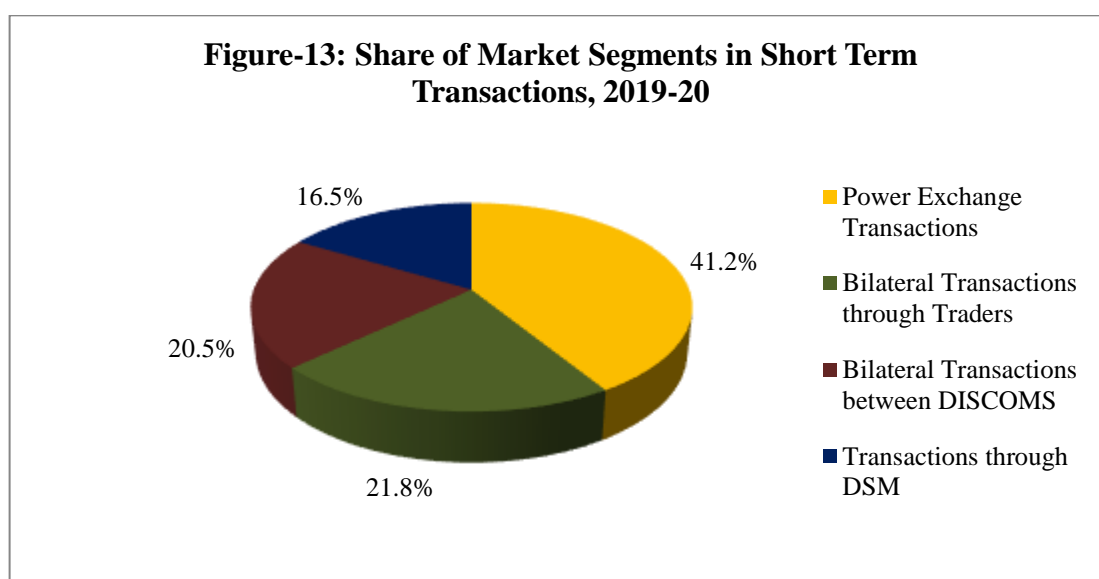

Of the total short term transactions in 2019-20, the volume of electricity transacted through power exchanges is the maximum (41.2%), followed by bilateral transactions through traders (21.8%), bilateral transactions between DISCOMs (20.5%) and transactions through DSM (16.5%).

3.1 Volume of Short-term Transactions of Electricity

The volume of short-term transactions of electricity during different months of 2019-20 with break-up for different segments is shown in Table-16 and Figure-14.


Table-16: Volume of Short-term Transactions of Electricity (BU), 2019-20

Period	Bilateral through Traders	Bilateral between DISCOMS	Total Bilateral transactions	Power Exchange transactions (DAM+TAM)	Transactions through DSM	Total Short-term transactions	Total Electricity Generation
Apr-19	2.90	2.44	5.34	4.66	1.68	11.68	108.93
May-19	2.47	2.89	5.36	4.21	1.82	11.39	116.75
Jun-19	2.98	2.40	5.38	4.71	1.97	12.06	112.83
Jul-19	4.26	2.55	6.81	5.50	2.10	14.41	108.36
Aug-19	4.22	2.47	6.69	5.96	2.34	14.98	105.50



Sep-19	3.84	3.01	6.85	4.32	2.06	13.22	104.59
Oct-19	1.47	2.12	3.59	4.29	2.06	9.93	98.89
Nov-19	1.11	2.75	3.86	3.96	1.62	9.44	93.54
Dec-19	1.38	2.44	3.82	4.91	1.73	10.46	98.76
Jan-20	1.58	2.23	3.80	5.09	1.81	10.70	102.84
Feb-20	1.72	1.49	3.21	4.55	1.62	9.37	101.13
Mar-20	2.02	1.39	3.41	4.31	1.79	9.51	96.06
Total	29.95	28.17	58.12	56.45	22.59	137.16	1248.17

It is observed from Figure-14 that there is a cyclical trend in the monthly volume of short-term transactions of electricity. A similar trend is also observed in the power exchange transactions. As expected, there is no cyclical trend in the transactions through DSM since these transactions do not move by seasonal variations.

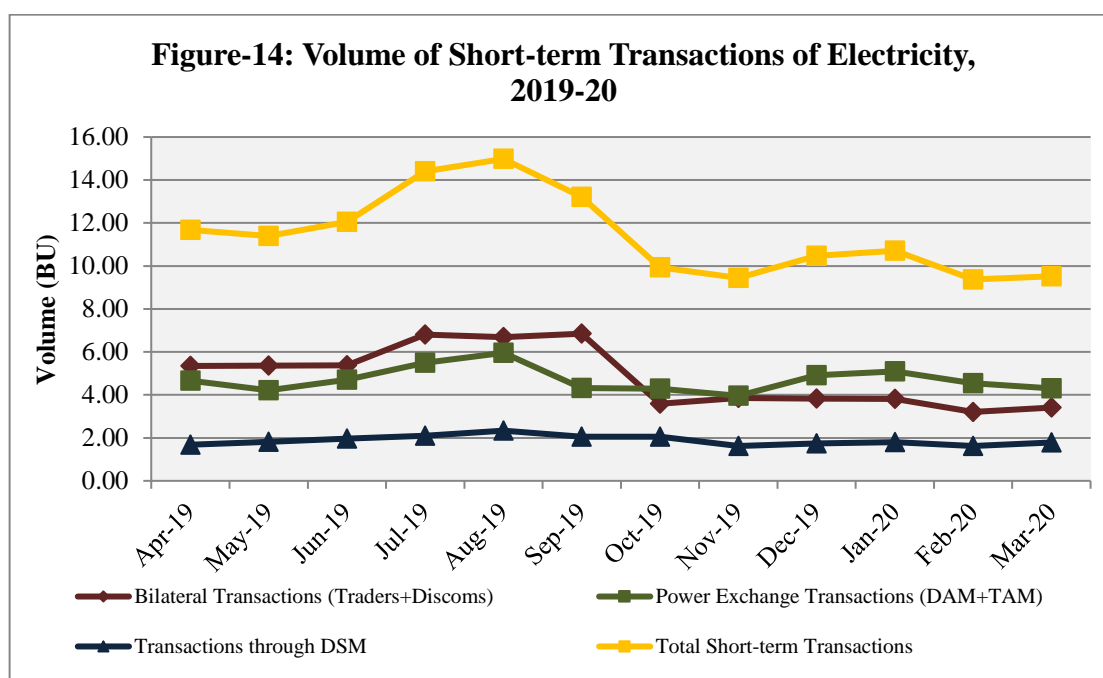

The volume of short-term transactions of electricity as percentage of total electricity generation varied between 9.27% and 14.20% during the months from April 2019 to March 2020 (Table-17).

Table-17: Volume of Short-term Transactions of Electricity as % of Total Electricity Generation, 2019-20

Period	Short-term Transactions as % of Total Electricity Generation
Apr-19	10.73%
May-19	9.75%
Jun-19	10.69%
Jul-19	13.30%
Aug-19	14.20%
Sep-19	12.64%
Oct-19	10.04%
Nov-19	10.09%
Dec-19	10.60%
Jan-20	10.41%
Feb-20	9.27%
Mar-20	9.90%

There were 34 inter-state trading licensees as on 31.3.2020. Of the total, 25 trading licensees actively undertook trading during the year 2019-20 (Table-18).

The volume of electricity transacted through traders/trading licensees (inter-state bilateral transactions and transactions through Power Exchanges) has been analysed using the Herfindahl-Hirschman Index (HHI) for measuring competition among the traders (Table-18). Increase in the HHI generally indicates a decrease in competition and an increase of market power, whereas decrease indicates the opposite. HHI value below 0.15 indicates unconcentration of market power, the value between 0.15 to 0.25 indicates moderate concentration, the value above 0.25 indicates high concentration of market power. The HHI, based on the volume of electricity transacted through traders during 2019-20 was 0.1587, which indicates moderate concentration of market power among the traders.


Table-18: Share of Electricity Transacted by Trading Licensees, 2019-20

Sr No	Name of the Trading Licensee	Share of Electricity transacted, 2019-20	Herfindahl-Hirschman Index (HHI)
1	PTC India Ltd.	33.26%	0.1106
2	Manikaran Power Ltd.	10.81%	0.0117
3	Kreate Energy (I) (P) Ltd.	10.60%	0.0112




4	Adani Enterprises Ltd.	9.18%	0.0084
5	Arunachal Pradesh Power Corporation (P) ltd	8.02%	0.0064
6	Tata Power Trading Company (P) Ltd.	6.69%	0.0045
7	GMR Energy Trading Ltd.	4.76%	0.0023
8	NTPC Vidyut Vyapar Nigam Ltd.	3.87%	0.0015
9	Jaiprakash Associates Ltd.	2.83%	0.0008
10	NHPC Ltd	2.27%	0.0005
11	Knowledge Infrastructure Systems (P) Ltd	1.60%	0.0003
12	Essar Electric Power Development Corp. Ltd.	1.24%	0.0002
13	Statkraft Markets (P) Ltd.	1.00%	0.0001
14	National Energy Trading & Services Ltd.	0.82%	0.0001
15	JSW Power Trading Company Ltd	0.80%	0.0001
16	Instinct Infra & Power Ltd.	0.68%	0.0000
17	RPG Power Trading Company Ltd.	0.50%	0.0000
18	Refex Energy Ltd.	0.26%	0.0000
19	Shree Cement Ltd.	0.21%	0.0000
20	Gita Power & Infrastructure (P) Ltd.	0.20%	0.0000
21	IPCL Power Trading (P) Ltd.	0.15%	0.0000
22	Abja Power Private Ltd.	0.11%	0.0000
23	Customized Energy Solutions India (P) Ltd.	0.10%	0.0000
24	Phillip Commodities India (P) Ltd.	0.04%	0.0000
25	NLC India Ltd.	0.01%	0.0000
Total Volume		100.00%	0.1587
Share of the Top 5 Trading Licensees		71.87%	
<i>Note: Percentage share in total volume traded by Licensees in 2019-20 is computed based on the volume which includes the volume traded by inter-state trading licensees through bilateral and power exchanges.</i>			
<i>Source: Information submitted by Trading Licensees.</i>			

The percentage share of electricity transacted by major traders in the total volume of electricity transacted by all the traders is shown in Figure-15.

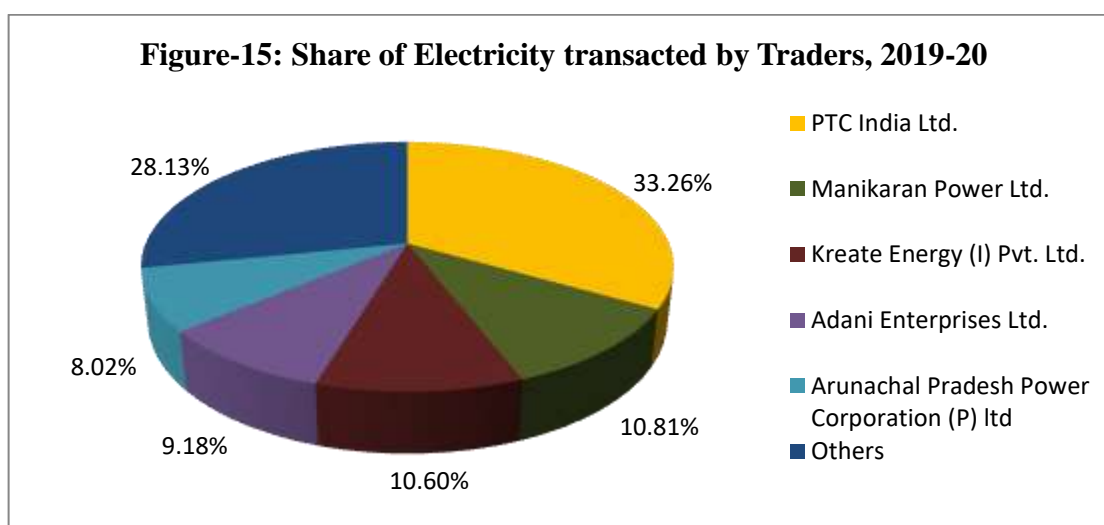

The concentration of market power (HHI) based on the volume of electricity transacted through traders and the number of traders has been shown in Figure-16. It can be observed from the figure that number of traders, who were undertaking trading bilaterally or through power exchanges or through both, increased from 14 in 2009-10 to 25 in 2019-20, whereas the concentration of market power declined from HHI of 0.24 in 2009-10 to HHI of 0.16 in 2019-20. It can also be observed that there is an inverse relationship between the number of traders and the HHI. The competition among the traders resulted into an increase in volume and decrease in prices in the short-term bilateral market (Table-13).

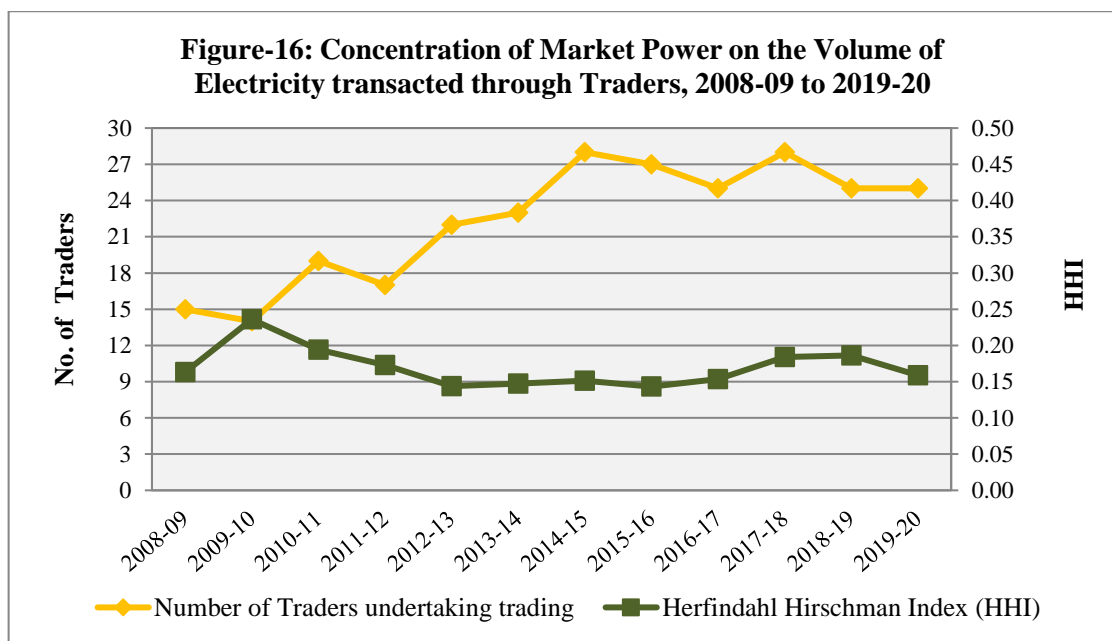


3.2 Price of Short-term Transactions of Electricity

The monthly trends in price of short-term transactions of electricity are shown in Table-19 and Figure-17 & 18. The price analysis is mainly based on the average price of DSM and the weighted average price of other short-term transactions of electricity. The price of bilateral trader transactions represents the price of electricity transacted through traders. The trends in price of electricity transacted through traders (bilateral trader transactions) were studied separately for total transactions as well as for the transactions undertaken during Round the Clock (RTC), Peak and Off-peak periods.

Table-19: Price of Short-term Transactions of Electricity (₹/KWh), 2019-20

Month	Bilateral through Traders				Power Exchange		DSM
	RTC	Peak	Off-peak	Total	IEX	PXIL	All India Grid
Apr-19	5.01	6.49	5.98	5.15	3.33	3.71	3.03
May-19	4.18	6.93	5.76	4.54	3.51	3.55	3.23
Jun-19	4.32	6.92	5.61	4.86	3.53	3.48	3.31
Jul-19	4.18	5.85	5.01	4.53	3.59	3.20	2.91
Aug-19	4.10	5.57	5.09	4.53	3.46	3.10	3.04
Sep-19	4.14	5.74	5.31	4.56	2.87	2.85	2.50
Oct-19	3.80	5.64	5.25	4.61	2.87	2.48	2.45
Nov-19	3.68	3.82	3.51	3.61	2.94	3.02	2.49
Dec-19	3.83	-	4.99	3.94	3.05	2.93	2.83
Jan-20	4.46	-	4.58	4.48	3.03	2.85	2.93
Feb-20	4.23	-	4.16	4.20	3.02	3.14	3.00
Mar-20	4.01	-	3.92	4.00	2.56	-	2.42

(-) No price due to no transactions during the month.

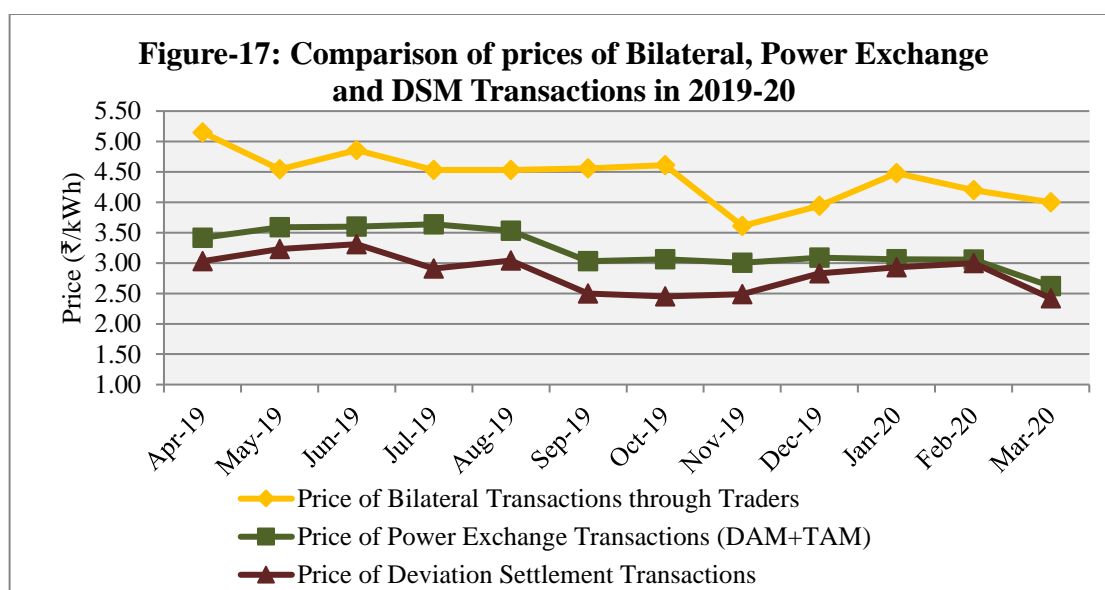


It can be observed from the above figure that the price of electricity transacted through traders was relatively high when compared with the price of electricity transacted through power exchanges in all the months in 2019-20⁶. The price of

⁶ The comparison between the price of power exchanges and the price of bilateral transactions should also be seen in the light that the delivery point for transactions of power exchanges is the periphery of regional transmission system in which the grid connected entity is located whereas the delivery point for bilateral transactions may

electricity transacted through power exchanges was relatively high when compared with the price of electricity transacted through DSM.

The trends in price of electricity transacted by traders during RTC, Peak and Off-peak periods are shown in Table-19 & Figure-18. It can be observed from the figure that the price of electricity during peak period was higher in all the months in 2019-20. There is no price for electricity transacted during peak from November 2019 to March 2020 for the reason that there is no volume of electricity transacted exclusively during peak period in these months.

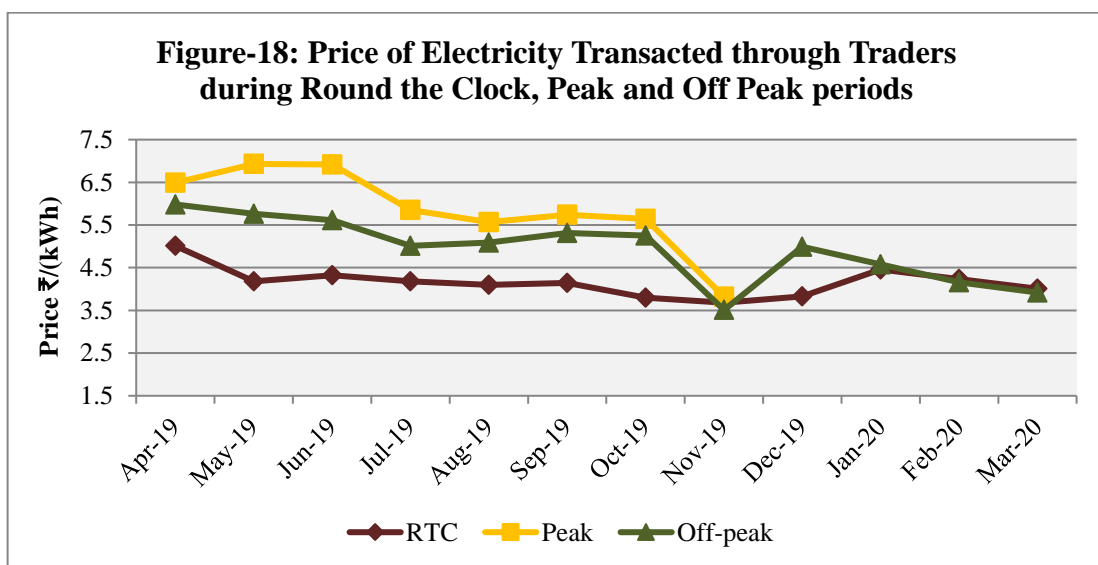


3.3 Volume of Electricity Transacted in Various Price Slabs


Volume of electricity transacted in various price slabs is shown for bilateral trader segment and power exchange segment separately. In the case of power exchanges, Day Ahead Market sub-segment has been considered.

Volume of bilateral transactions at different price slabs in 2019-20 is depicted in Figure-19. The figure shows that 23.4% of the volume of electricity was transacted through traders at less than ₹4/kWh and 91.1% of the volume was transacted through traders at less than ₹6/kWh.

vary from transaction to transaction. The delivery point may be state or regional periphery or any other point as per the contract executed.

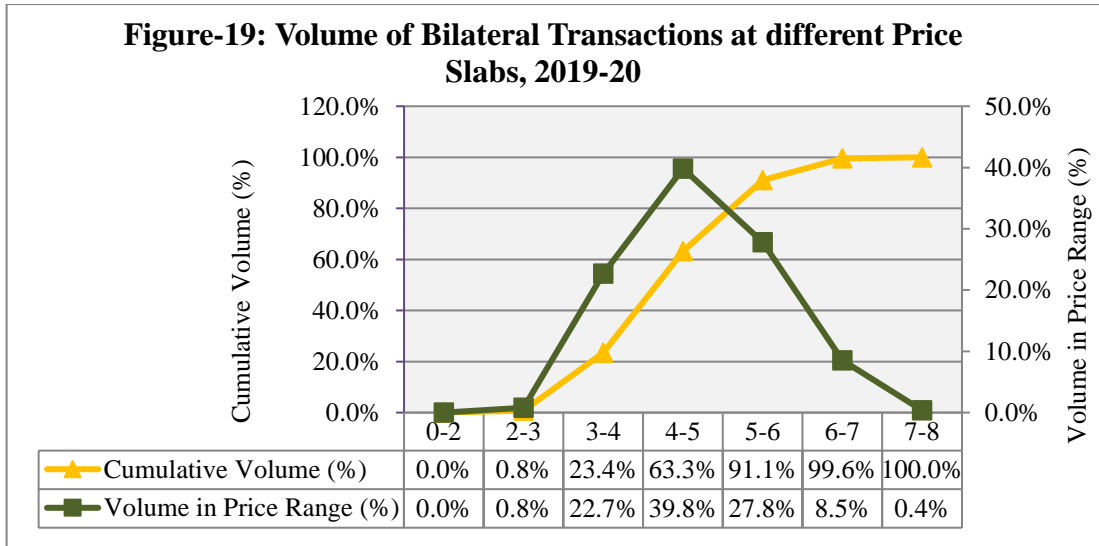


Volume of IEX transactions at different price slabs in 2019-20 is depicted in Figure-20. The figure shows that 87% of the volume of electricity was transacted through IEX at less than ₹4/kWh and 98% of the volume was transacted through IEX at less than ₹6/kWh.

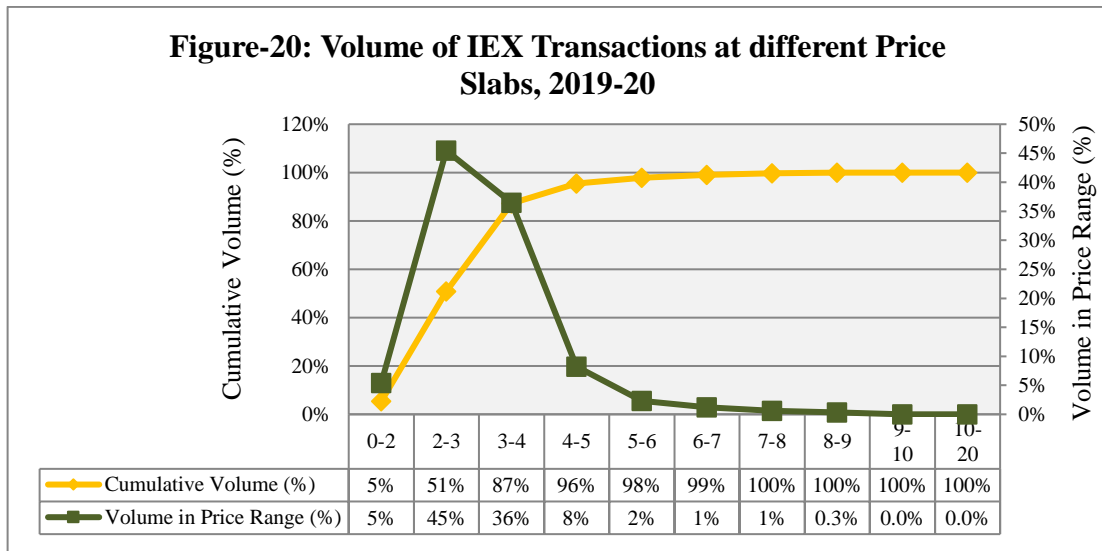

Volume of PXIL transactions at different price slabs in 2019-20 is depicted in Figure-21. The figure shows that 97% of the volume of electricity was transacted through PXIL at less than ₹4/kWh and 100% of the volume was transacted through PXIL at less than ₹5/kWh.

Figure-21: Volume of PXIL Transactions at different Price Slabs, 2019-20

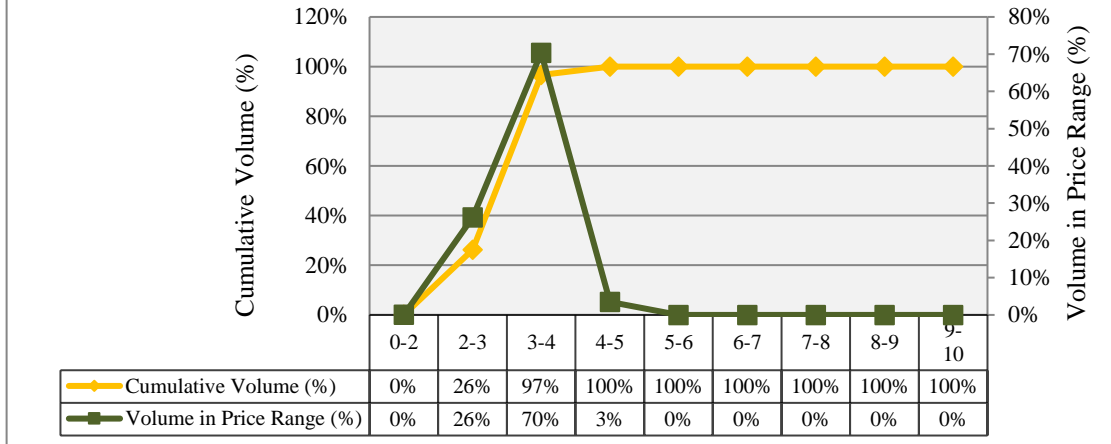


4. Daily Trends in Short-term Transactions of Electricity (1st April 2019 to 31st March 2020)

4.1 Volume of Short-term Transactions of Electricity

Trends in daily volume of short-term transactions are shown in Figure-22. It can be observed from the figure that there was a cyclical trend in the volume of electricity transacted through power exchanges during 2019-20. It can also be observed that there was irregular trend in the volume of electricity transacted through bilateral transactions and DSM during the year.

Figure-22: Volume of Short-term Transactions of Electricity, 2019-20

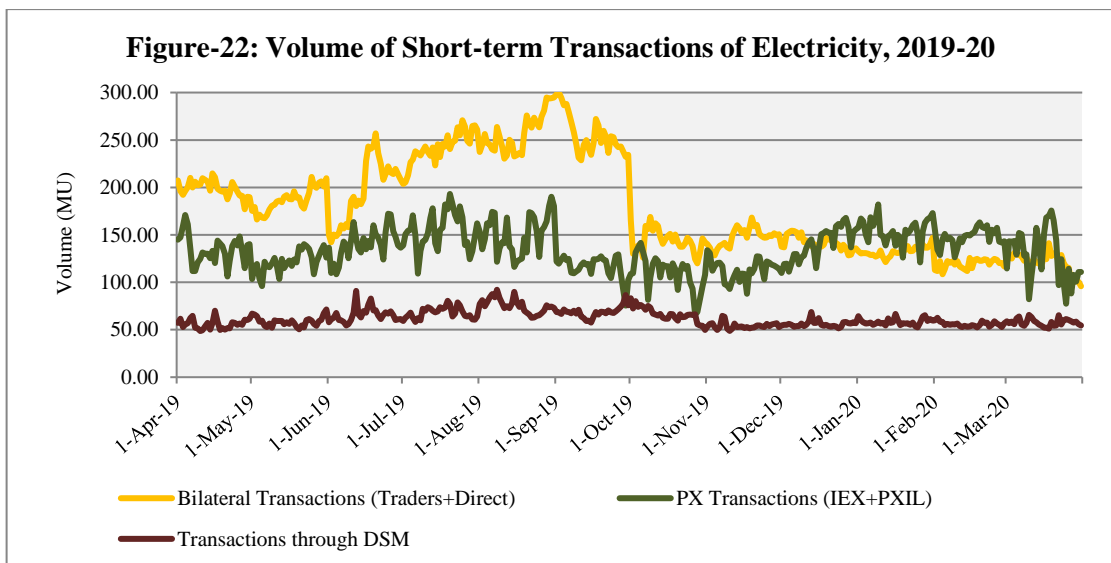


4.2 Price of Short-term Transactions of Electricity

Price and its volatility in the daily price of short-term transactions of electricity through power exchanges and DSM have been analysed in this section. Volatility has been computed using the historic volatility formula (See Annexure-III for formula).


4.2.1 Price and its volatility in Power Exchanges

The weighted average price of electricity transacted through IEX and its volatility is shown in Figure-23. Volatility in the Price of electricity transacted through IEX has been computed using daily data for 2019-20 and it works out to 9.36%.

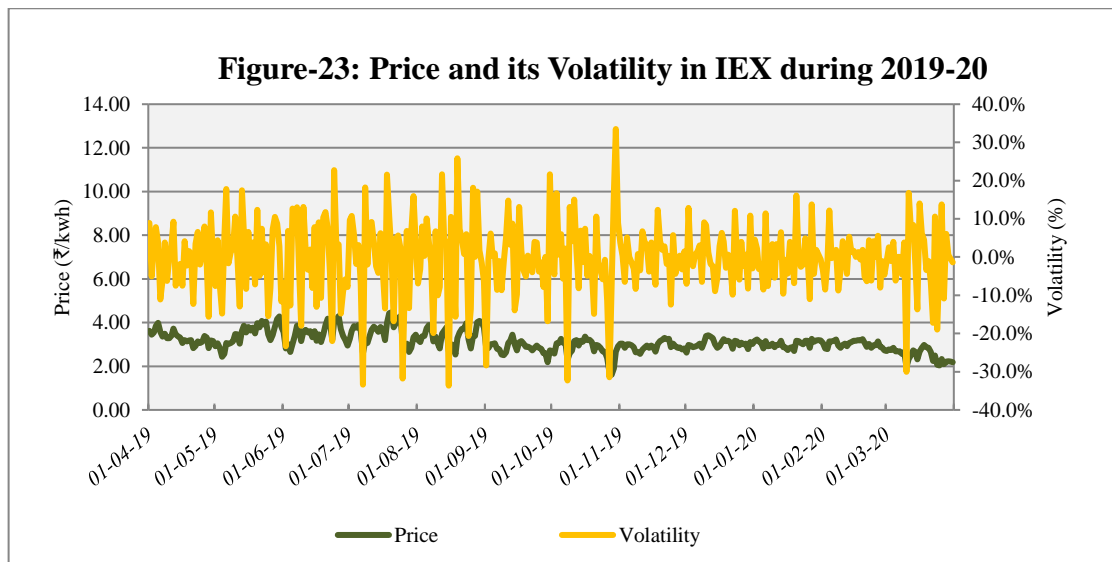


The weighted average price of electricity transacted through PXIL and its volatility is shown in Figure-24. Volatility in the price of electricity transacted through PXIL has been computed using daily data for 2019-20 and it works out to 11.07%.

The volatility in the price of electricity transacted through PXIL is relatively high when compared with the volatility in the price of electricity transacted through IEX and this could be due to low volume of electricity transacted through PXIL.

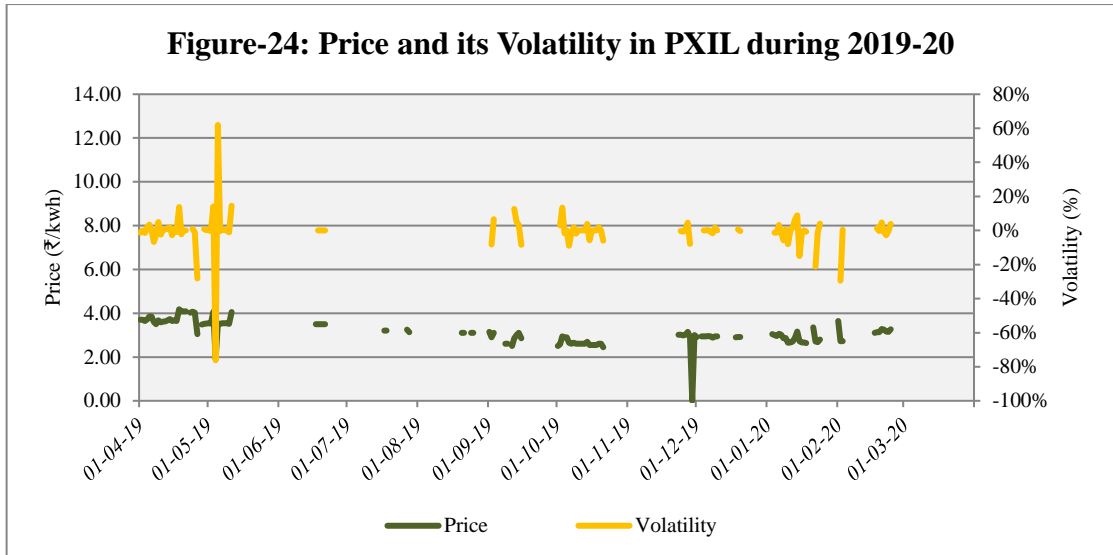

4.2.2 Price and its volatility in DSM

The average price of electricity transacted through DSM and its volatility is shown in Figure-25. Volatility in the price of electricity transacted through DSM has been computed using daily data for 2019-20 and it works out to 24.08%.

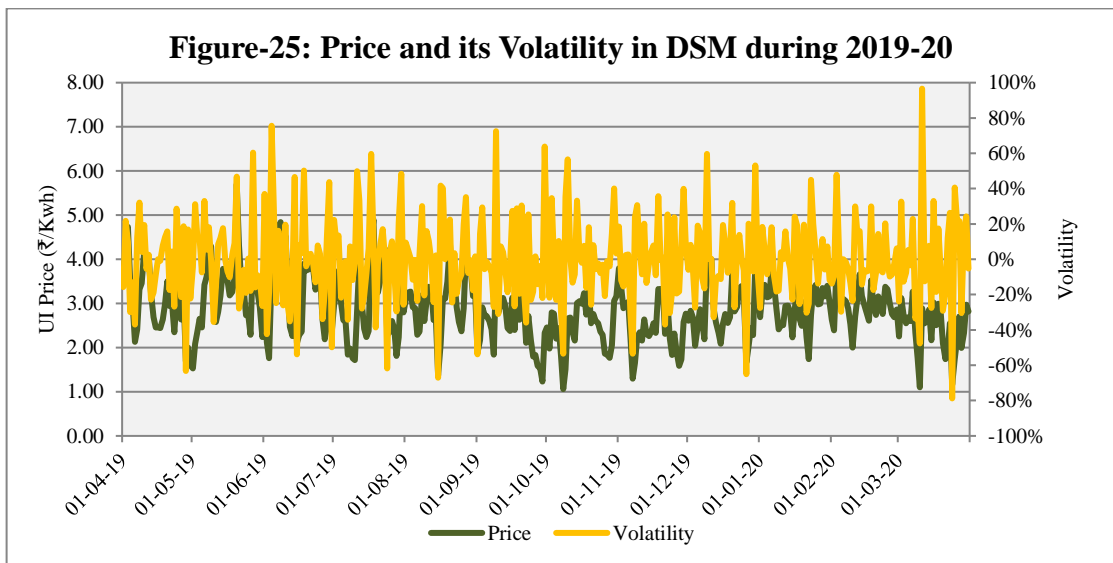


The nature of electricity transactions through DSM are different from electricity transactions through power exchanges, therefore, the volatility in the price of electricity transacted through DSM is high (24.08%) when compared with the volatility in the price of electricity transacted through power exchanges (9.36% in IEX and 11.07% in PXIL).

5. Time of the Day Variation in Volume and Price of Electricity Transacted through Traders and Power Exchanges

In this section, time of the day variation in volume and price of electricity transacted through traders has been illustrated for RTC (Round the Clock), Peak period and other than RTC & Peak period. Time of the day variation in volume and price of electricity transacted through power exchanges is shown block-wise. Price of electricity transacted through power exchanges is also shown region-wise and block-wise.



5.1 Time of the Day Variation in Volume and Price of Electricity Transacted through Traders

Time of the day variation in volume and price of electricity transacted through bilateral traders' transactions during 2019-20 is shown in Figure-26. The volume of electricity transacted through traders represent inter-state transactions i.e. excluding banking transactions. Time of the day variation in volume is shown during RTC (Round the Clock), Peak period and OTP (other than RTC & Peak period). Of the total volume, 71.9% was transacted during RTC followed by 25.0% during OTP, and 3.1% during peak period. It can be observed from the figure that there is hardly any volume transacted during peak period. It can also be observed that the weighted average price during Peak period is high (₹5.96/kWh), when compared with the price during RTC (₹4.26/kWh) and OTP (₹5.27/kWh).


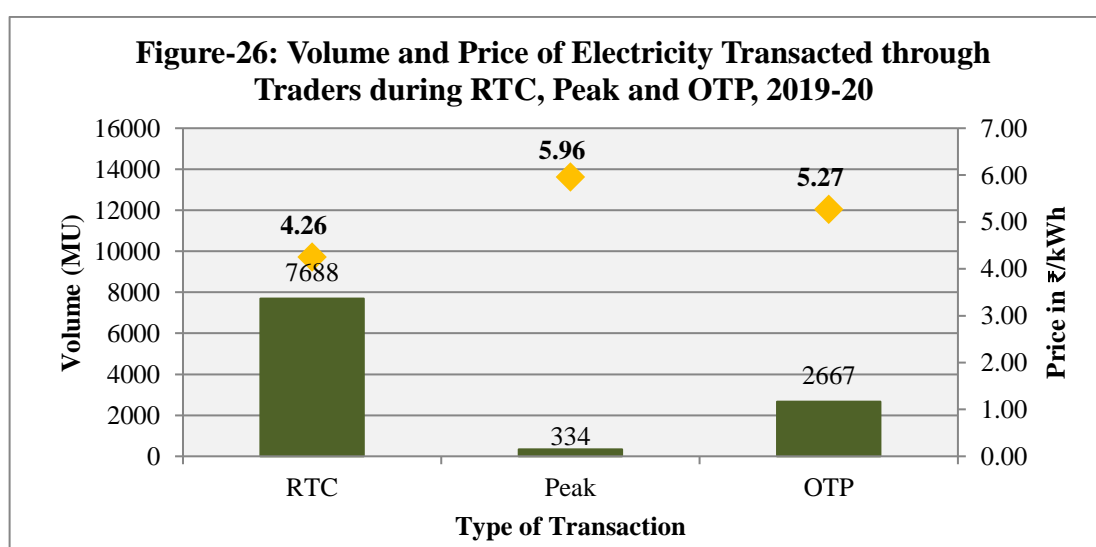


5.2 Time of the Day Variation in Volume and Price of Electricity Transacted through Power Exchanges

Time of the day variation in volume and price of electricity transacted through IEX and PXIL (Day ahead market) during 2019-20 are shown block-wise in Figure-27 and Figure-28 respectively. It can be observed from the figure that the weighted average price in both the power exchanges was higher during peak period (between hours 18:00 to 23:00), when compared to the weighted average price in rest of the hours.

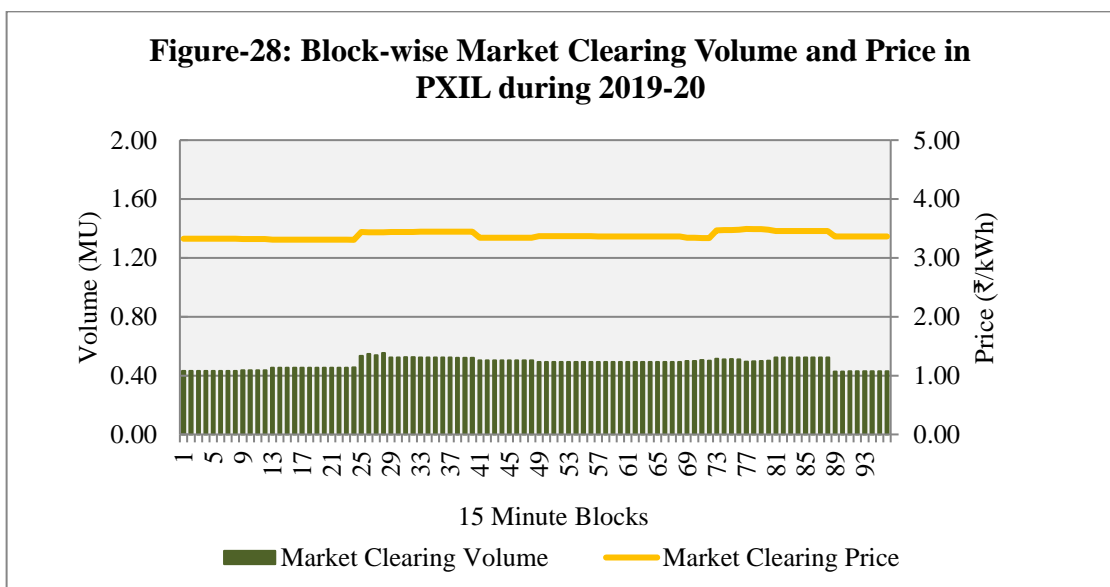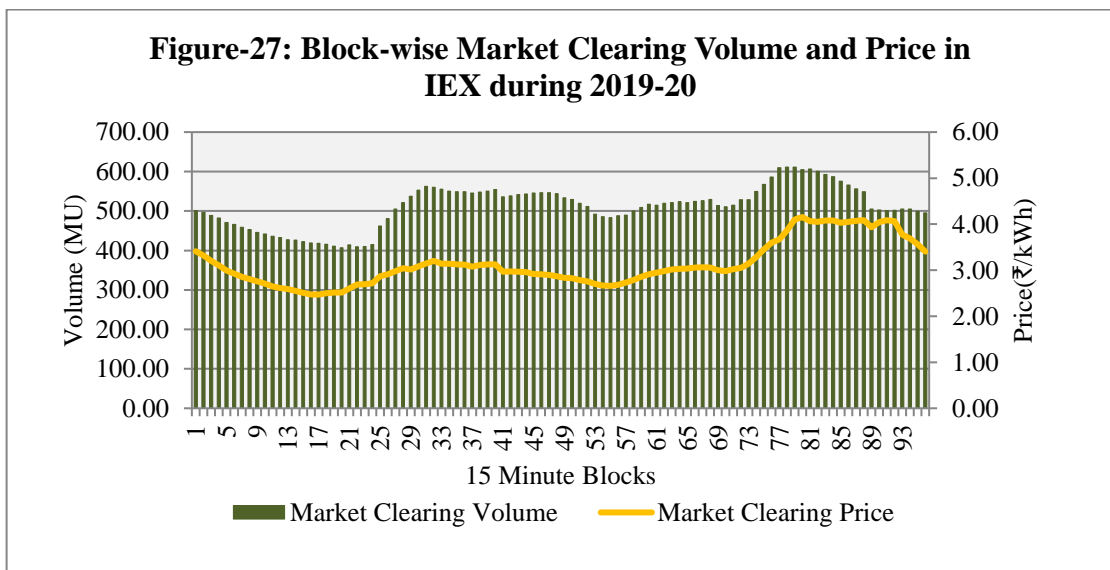

Region-wise and hour-wise prices of electricity transacted through power exchanges are shown in Figure-29 and Figure-30. It can be observed from the figures that during 2019-20, the price of electricity in southern region (S1, S2 and S3 regions) was marginally high during peak period when compared with the price in other regions in IEX. This is mainly due to high demand for electricity in the southern region. The prices were high due to congestion between southern region and rest of the regions, accompanied by market splitting on the power exchanges. The price of electricity in northern region was relatively low when compared with the price in other regions in PXIL.

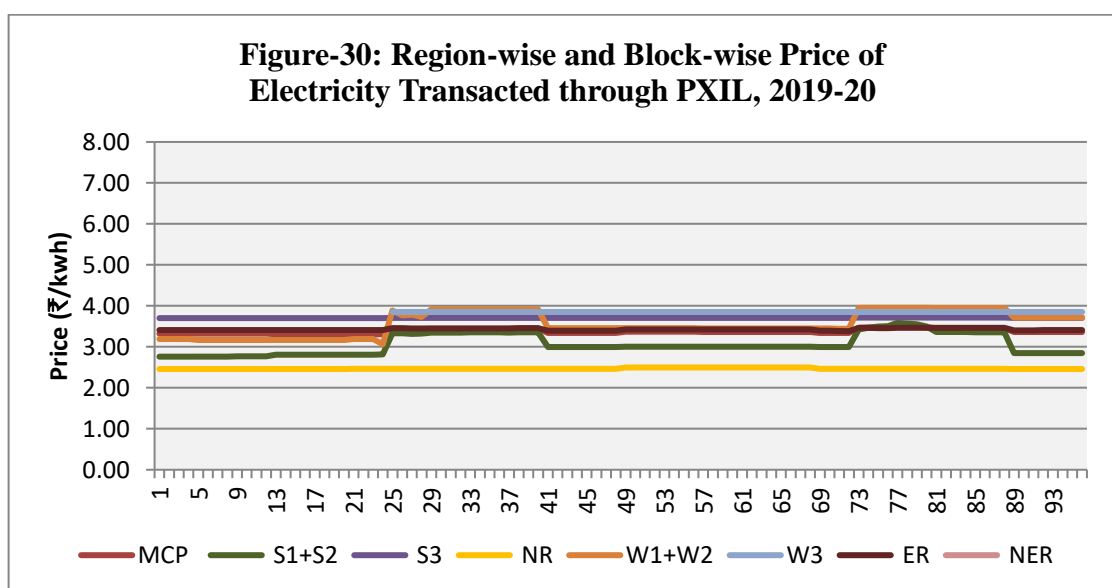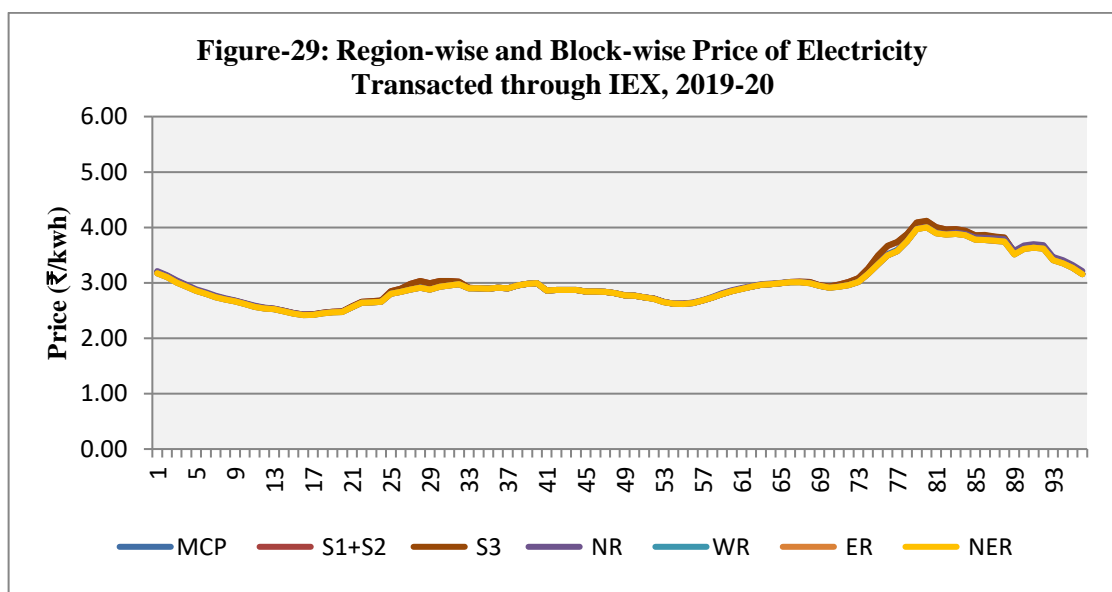

6. Trading Margin Charged by Trading Licensees

During the year 2004-05 (when trading started through licensees), the licensees voluntarily charged 5 paise/kWh or less as the trading margin for bilateral transactions. However, trading margin increased in 2005 and the weighted average trading margin charged by the licensees went up to 10 paise/kWh during April to September 2005 period. This has necessitated to fix trading margin for inter-state trading of electricity. The trading margin was fixed at 4 paise/kWh, vide, CERC (Fixation of Trading Margin) Regulations notification dated 26.1.2006. As a result of these trading margin regulations, the licensees charged trading margin of 4 paise or less from 26.1.2006 onwards until revised Trading Margin Regulations, 2010 came into existence on 11.1.2010 (Table-20 & Figure-31).

Based on feedback and experience gained from 2006 Regulations and considering various risks associated with the electricity trading business, CERC revised the trading margin in 2010. As per the CERC (Fixation of Trading Margin) Regulations, 2010, the trading licensees are allowed to charge trading margin up to 7 paise/kWh in case the sale price exceeds ₹3/kWh, and 4 paise/kWh where the sale price is less than or equal to ₹3/kWh.


For increasing the volume of trading, some of the trading licensees have misunderstood the intention of the trading margin regulations and charged negative trading margin for some of the transactions. Keeping this in view and to avoid negative trading margin, the Commission, in the CERC (Procedure, Terms and Conditions for grant of trading licence and other related matters) Regulations, 2020, has prescribed the trading margin of non less than zero (0.0) paise/kWh and not exceeding seven (7.0) paise/kWh w.e.f 31st January, 2020. In these regulations, the applicability of trading margin has been clearly specified separately for transactions under (a) short-term contracts, (b) long-term contracts, (c) banking contracts, (d) back to back contracts and (e) cross border trade of electricity. The trading licensees have been charging the trading margin as per the regulations. Due to stiff competition among the trading licensees, the trading margin charged by the trading licensees was always less than the ceiling margin allowed in the trading margin regulations. The new trading margin regulations restrict

the trading licensees from charging negative trading margin i.e. less than zero (0.0) paise/kWh. The weighted average trading margin charged by the trading licensees for bilateral transactions during 2009-10 to 2019-20 is provided in Table-20 and Figure-31.

Table -20: Trading Margin Charged by Trading Licensees, 2009-10 to 2019-20

Year	Trading Margin (₹/kWh)
2009-10	0.040
2010-11	0.050
2011-12	0.050
2012-13	0.041
2013-14	0.035
2014-15	0.038
2015-16	0.032
2016-17	0.032
2017-18	0.031
2018-19	0.032
2019-20	0.031

Note 1: Weighted Average Trading Margin is computed based on all Inter-state Trading Transactions excluding Banking Transactions

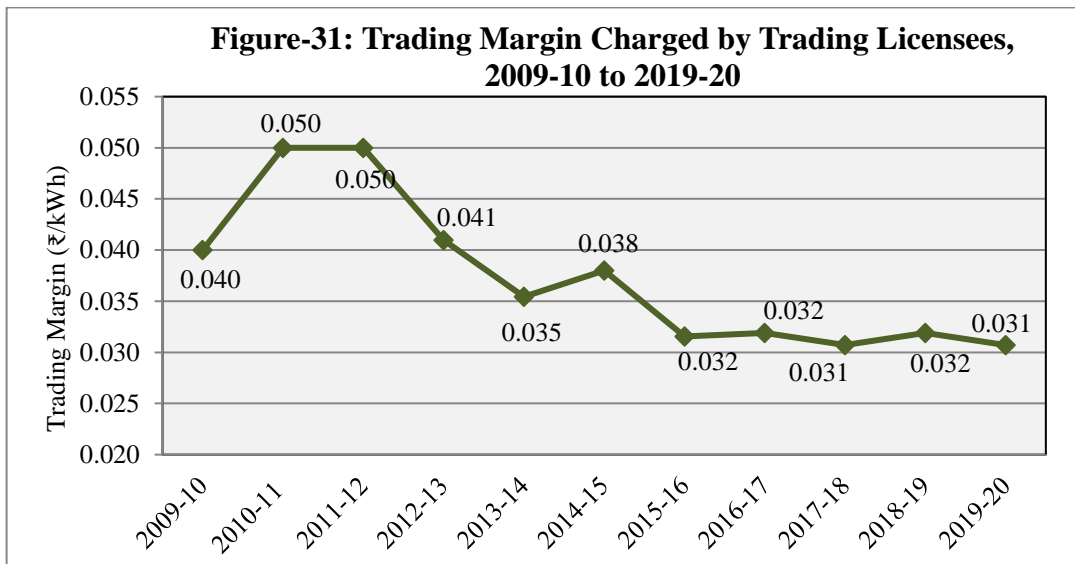


It can be observed from the above figure that, though trading margin is allowed upto 7 paise/kWh as per the trading licence regulations, the trading margin charged by the trading liacensees has been stable and it was around 3 paise/kWh during the period from 2015-16 to 2019-20. This is mainly due to competition among the trading licensees.

7. Open Access Consumers on Power Exchanges


This section contains analysis of various types of participants and analysis of open access consumers in day ahead market of power exchanges.

7.1 Types of Participants in Power Exchanges

There are five types of participants in IEX, as shown in Figure-32. It can be observed from the figure that major sellers of electricity through IEX were independent power producers and state utilities. It can also be observed that major buyers of electricity through IEX were state utilities followed by open access consumers, and private distribution licensees.

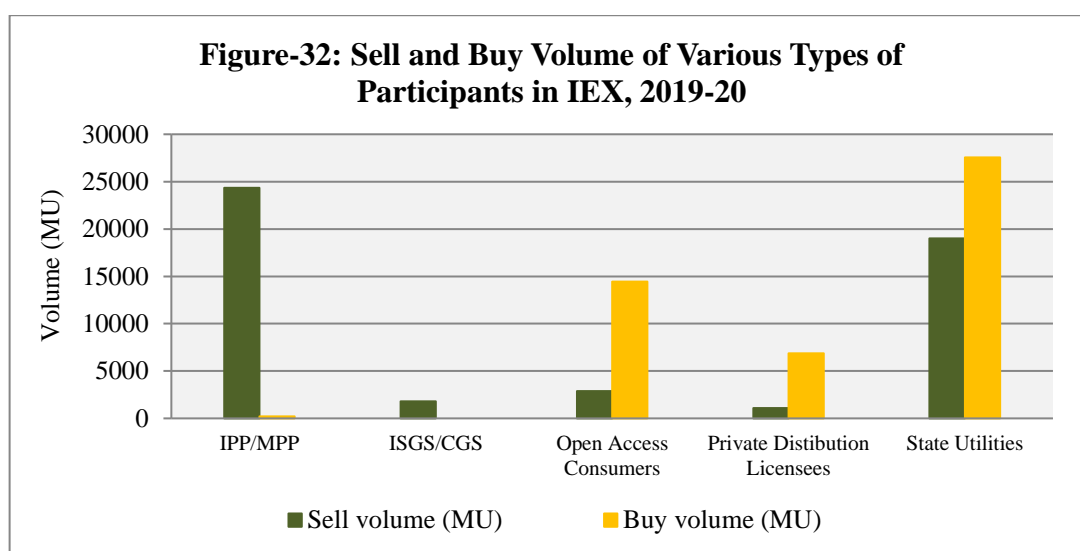

There are 3 types of participants in PXIL, as shown in Figure-33. It can be observed from the figure that major sellers of electricity through PXIL were state utilities and Independent Power Producers. It can also be observed that major buyers of electricity through PXIL were state utilities and open access consumers.

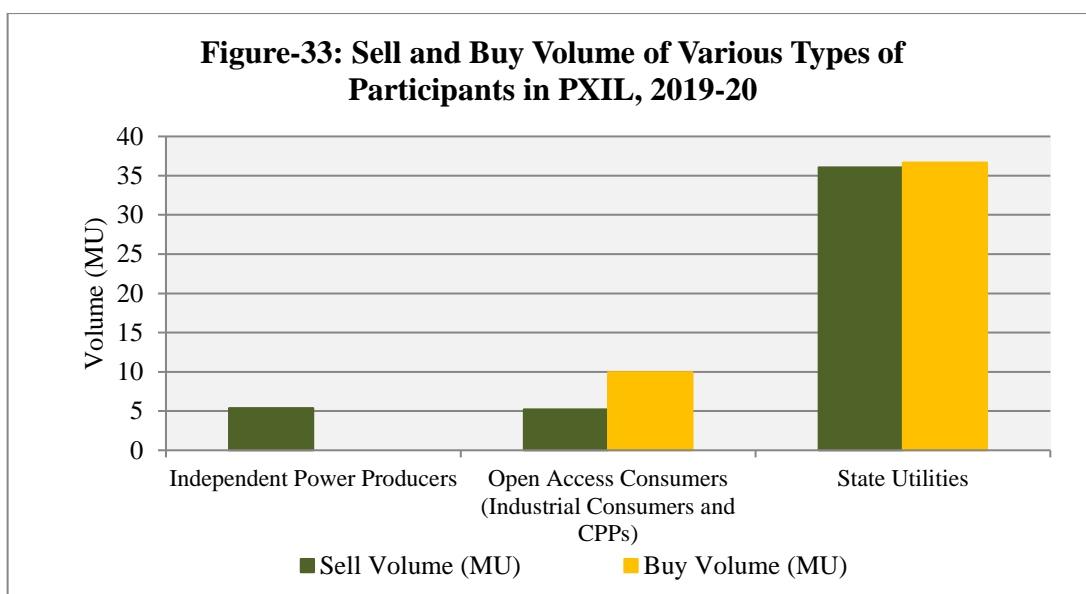

7.2 Analysis of Open Access Consumers on Power Exchanges

The year 2010-11 witnessed collective open access transactions, a significant development in procurement of power by the industrial consumers through power exchanges. The number of Open Access (OA) Consumers in both IEX and PXIL increased from 825 and 170 respectively in 2010-11 to 4555 and 615 respectively in 2019-20 (Table-21). During the period, the percentage of open access consumers in total portfolios varied between 90% to 96% in IEX whereas the percentage varied between 16% to 89% in PXIL. The number of OA consumers in IEX increased at an annual growth of 21%, whereas it was 15% in PXIL. Though there is an increasing trend in the number of OA consumers in PXIL, the percentage of open access consumers in total portfolio of PXIL declined significantly from 89% in 2010-11 to 16% in 2019-20.


Table-21: Number of Open Access Consumers in Power Exchanges, 2010-11 to 2019-20

Year	IEX			PXIL		
	No. of Open Access Consumers	Total No. of Portfolios	% of Open Access Consumers	No. of Open Access Consumers	Total No. of Portfolios	% of Open Access Consumers
2010-11	825	863	96%	170	190	89%
2011-12	968	1073	90%	231	465	50%




2012-13	2110	2227	95%	336	379	89%
2013-14	2958	3083	96%	473	1399	34%
2014-15	3269	3407	96%	517	1779	29%
2015-16	3650	3796	96%	527	2924	18%
2016-17	4071	4281	95%	542	3277	17%
2017-18	4248	4502	94%	559	3422	16%
2018-19	4362	4633	94%	588	3657	16%
2019-20	4555	4857	94%	615	3780	16%

In 2019-20, about 4555 OA consumers procured 14453 MU of electricity (a part of their power requirements) through IEX. These OA consumers were mostly located in Tamil Nadu, Andhra Pradesh, Gujarat, Haryana, Punjab, Rajasthan, Karnataka and Uttarakhand (Figure-34). The weighted average price of electricity bought by OA consumers at IEX was lower (₹2.84/kWh) when compared to the weighted average price of total electricity transacted through IEX (₹3.16/kWh).

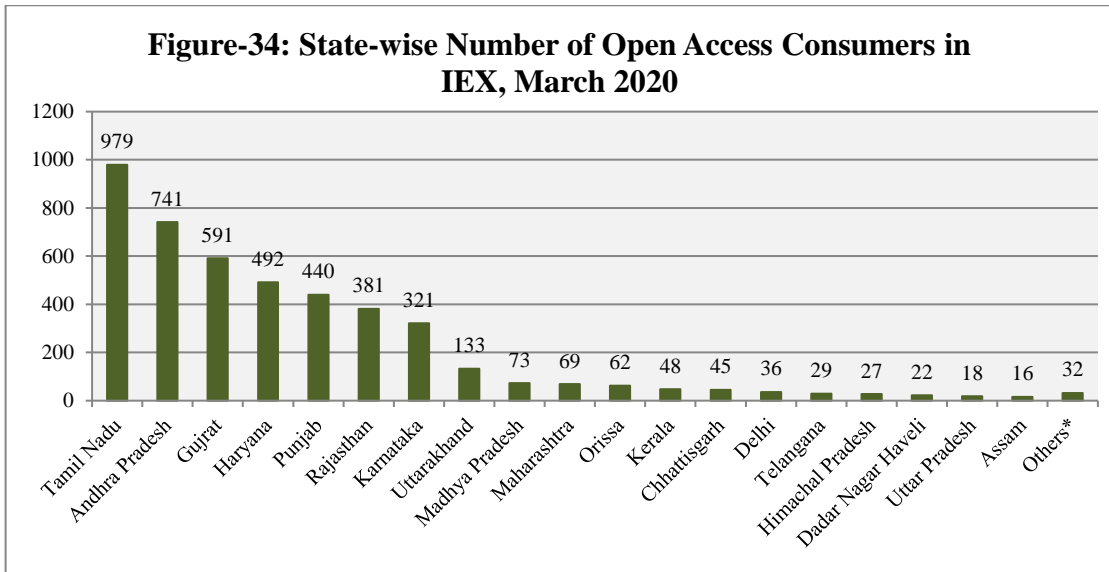

About 615 OA consumers procured 10 MU of electricity (a part of their power requirements) through PXIL in 2019-20. These consumers were mostly located in Tamil Nadu, Gujarat, Punjab, Chhattisgarh and Karnataka (Figure-35). The weighted average price of electricity bought by open access consumers at PXIL was lower (₹3.22/kWh) when compared to the weighted average price of total electricity transacted through PXIL (₹3.38/kWh).

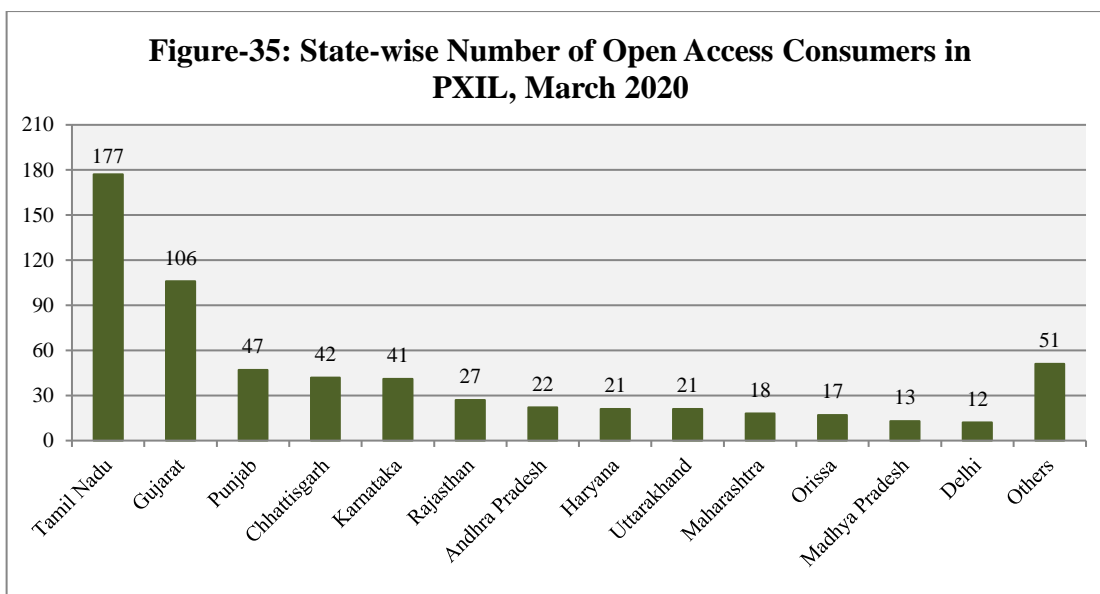

Annual comparison between purchase volume of OA consumers and total volume in both IEX and PXIL during 2010-11 to 2019-20 is shown in Table-22. The volume of electricity procured by OA consumers as a percentage of total volume transacted in IEX varied between 22% and 61% in IEX. The volume of electricity procured by OA consumers as a percentage of total volume transacted in PXIL varied between 1% and 58%.

Table-22: Volume of Purchase by Open Access Consumers in Day Ahead Market of Power Exchanges, 2010-11 to 2019-20

Year	IEX			PXIL		
	OAC Purchase Volume (MU)	Total Volume (MU)	% OAC Purchase Participation	OAC Purchase Volume (MU)	Total Volume (MU)	% OAC Purchase Participation
2010-11	4057	11801	34%	93	1740	5%
2011-12	6275	13799	45%	307	2058	15%
2012-13	10410	22375	47%	263	688	38%
2013-14	17575	28925	61%	503	1106	45%
2014-15	12084	28141	43%	103	341	30%
2015-16	20284	34067	60%	79	137	58%
2016-17	24000	39831	60%	44	249	18%
2017-18	14728	44925	33%	6	730	1%
2018-19	11219	50136	22%	21	86	24%
2019-20	14453	49126	29%	10	47	21%

8. Major Sellers and Buyers of Electricity in the Short-term market

Table-23 and Table-24 show top 10 sellers and buyers of electricity through traders (bilateral trader segment transactions). The same data for IEX is shown in Table-25 and Table-26, and for PXIL in Table-27 and Table-28. It can be seen that the dominant sellers, both at the power exchanges and traders, are a mixed group comprising of independent power producers, distribution companies, and state government agencies. The major buyers from traders and at the power exchanges are mostly state distribution companies and industrial consumers. The volume of electricity transacted by these major sellers and buyers, their share in total volume and the price at which they have sold or purchased is also provided in the tables.

Table 23: Major Sellers of Electricity through Traders, 2019-20

S. No.	Name of the Seller	State	Volume (MU)	Approximate Percentage of total volume transacted through Traders	Weighted Average Price (₹/kWh)
1	Adani Power Ltd	Gujarat	1917.52	17.94%	4.08
2	Essar Power MP Ltd	Madhya Pradesh	1551.47	14.51%	5.58
3	HPSEB (including GOHP)	Himachal Pradesh	1222.40	11.44%	4.50
4	Sembcorp Energy India Ltd	Andhra Pradesh	944.38	8.83%	3.80
5	Jaypee Nigrie STPP	Madhya Pradesh	821.04	7.68%	5.35
6	Jindal Power Ltd	Chhattisgarh	533.21	4.99%	5.49
7	VS Lignite Power (P) Ltd	Rajasthan	461.39	4.32%	4.22
8	DB Power Ltd	Chhattisgarh	415.25	3.88%	4.46
9	Baglihar HEP Stage-II	Jammu Kashmir	356.26	3.33%	4.23
10	DGEN Mega Power Project	Gujarat	331.09	3.10%	4.74

Note : Volume sold by major sellers and total volume transacted through traders does not include the volume through banking arrangements.

Table 24: Major Buyers of Electricity through Traders, 2019-20

S. No.	Name of the Buyer	State	Volume (MU)	Approximate Percentage of total volume transacted through traders	Weighted Average Price (₹/kWh)
1	UPPCL	Uttar Pradesh	1662.83	15.56%	5.33
2	Nepal Electricity Authority	Nepal	1282.32	12.00%	4.25
3	WBSEDCL	West Bengal	1245.11	11.65%	3.88
4	BSPHCL	Bihar	950.85	8.89%	5.81
5	Adani Electricity Mumbai Ltd	Maharashtra	676.22	6.33%	3.57
6	Uttarakhand Power Corporation Ltd	Uttarakhand	541.76	5.07%	4.16
7	CSPDCL	Chhattisgarh	516.39	4.83%	4.91
8	Tata Power Delhi Distribution Limited	Delhi	458.68	4.29%	4.40
9	TANGEDCO	Tamil Nadu	371.85	3.48%	4.46
10	TSPCC	Telangana	366.98	3.43%	5.56

Note : Volume Bought by major buyers and total volume transacted through traders does not include the volume through banking arrangements.

From Table-24, it can be seen that the weighted average purchase prices of electricity of major buyers such as UPPCL, BSPHCL, CSPDCL, and TSPCC from traders (bilateral transactions) were higher than the weighted average price for the entire bilateral trader segment (₹4.51/kWh).

Table-25: Major Sellers of Electricity in the Day Ahead Market of IEX, 2019-20

S. No.	Name of Seller	State/Regional Entity	Sell Volume (MU)	Percentage of the Total Volume transacted in IEX	Weighted Average Sell Price (₹/KWh)
1	Teesta Urja Ltd	Sikkim	4622.86	9.41%	3.24
2	Sembcorp Energy India Ltd	Andhra Pradesh	2589.62	5.27%	3.24
3	MPPMCL	Madhya Pradesh	2142.80	4.36%	3.27

4	Jaypee Bina TPP	Madhya Pradesh	1602.92	3.26%	2.79
5	APDCL	Assam	1496.39	3.05%	2.67
6	GOHP	Himachal Pradesh	1458.19	2.97%	3.23
7	Raipur Energen Ltd	Chhattisgarh	1352.13	2.75%	3.06
8	Adani Power Ltd, Mundra	Gujarat	1291.86	2.63%	3.05
9	PCKL	Karnataka	1221.64	2.49%	2.79
10	GRIDCO	Orissa	1215.93	2.48%	3.04
<i>Note: Total Volume transacted through Day Ahead Market in IEX was about 49112.21 MU.</i>					

Table-26: Major Buyers of Electricity in the Day Ahead Market of IEX, 2019-20

S. No.	Name of Buyer	State/Regional Entity	Buy Volume (MU)	Percentage of the Total Volume Transacted in IEX	Weighted Average Buy Price (₹/kWh)
1	APCPDCL	Andhra Pradesh	4462.38	9.09%	3.09
2	BSPHCL	Bihar	3480.04	7.09%	3.61
3	Reliance Energy Ltd	Maharashtra	2498.15	5.09%	3.14
4	CGSEB	Chhattisgarh	1934.56	3.94%	3.42
5	WBSEDCL	West Bengal	1899.67	3.87%	3.59
6	GUVNL	Gujrat	1741.87	3.55%	3.25
7	J&K PDD	J&K	1550.23	3.16%	2.90
8	TNEB	Tamil Nadu	1490.53	3.03%	4.17
9	APSPDCL	Andhra Pradesh	1400.59	2.85%	3.45
10	Tata Power Delhi Distribution Ltd	Delhi	1070.86	2.18%	3.11
<i>Note: Total Volume transacted through Day Ahead Market in IEX was about 49112.21 MU.</i>					

From Table-26, it can be seen that the weighted average prices of electricity for major buyers such as BSPHCL, CGSEB, WBSEDCL, GUVNL, TNEB, and APSPDCL in the day ahead market of IEX were higher than the weighted average price for the entire day ahead market of IEX (₹3.16/kWh).

Table-27: Major Sellers of Electricity in Day Ahead Market of PXIL, 2019-20

S.No	Name of the Seller	State/Regional Entity	Sell Volume (MU)	Percentage of total volume transacted in PXIL	Weighted Average Sell Price (₹/ kWh)
1	DVC	DVC	27.54	59.07%	3.70
2	HPSEB	Himachal Pradesh	8.36	17.94%	2.47
3	Janki Corp Ltd	Karnataka	3.39	7.26%	2.86
4	Dikchu Hydro Electric Project	Sikkim	2.26	4.85%	3.61
5	Adani Power Ltd	Gujarat	2.23	4.78%	3.68
6	EDCL	Karnataka	1.82	3.90%	2.89
7	DB Power Ltd	Chhattisgarh	0.90	1.93%	3.85
8	MPPMCL	Madhya Pradesh	0.08	0.18%	3.31
9	GRIDCO Ltd	Odisha	0.05	0.11%	3.10

Note: Total Volume transacted in the Day Ahead Market of PXIL was about 46.63 MU.

From Table-28, it can be seen that the weighted average prices of electricity for major buyers such as Viswateja Spinning Mills Ltd and APPCC in the PXIL Day Ahead Market were higher than the weighted average price for the entire day ahead market of PXIL (₹3.38/kWh).

Table-28: Major Buyers of Electricity in Day Ahead Market of PXIL, 2019-20

Sr. No	Name of the Buyer	State/Regional Entity	Buy Volume (MU)	Percentage of the Total Volume Transacted in PXIL	Weighted Average Buy Price (₹/ kWh)
1	Kerala State Electricity Board	Kerala	28.41	60.93%	3.18
2	DVC	DVC	8.15	17.48%	3.01
3	Kirloskar Ferrous Industries Ltd	Karnataka	5.74	12.31%	3.36
4	Vijayaa Steels Ltd	Karnataka	3.71	7.95%	3.00
5	IFFCO Plant	Gujarat	0.23	0.49%	3.24
6	Viswateja Spinning Mills Ltd	Andhra Pradesh	0.17	0.37%	3.71

7	APPCC	Andhra Pradesh	0.12	0.25%	3.68
8	Kairali Steels and Alloys (P) Ltd	Kerala	0.09	0.20%	2.45
9	Krishna Ganga Spinning Mills (P) Ltd	Andhra Pradesh	0.01	0.03%	3.00
<i>Note: Total Volume transacted in the Day Ahead Market of PXIL was about 46.63 MU.</i>					

9. Effect of Congestion on the Volume of Electricity Transacted through Power Exchanges

The volume of electricity transacted through power exchanges is sometimes constrained due to transmission congestion. The details of congestion in both the power exchanges are shown in Table-29 and Table-30.

The effect of congestion on volume of electricity transacted through power exchanges during 2009-10 to 2019-20 is shown in Table-29. It can be observed from the table that there is an increasing trend in the unconstrained cleared volume and actual volume transacted. Unconstrained cleared volume and actual volume transacted increased from 8.10BU and 7.09BU respectively in 2009-10 to 49.36BU and 49.16BU respectively in 2019-20. There is an increasing trend in the volume of electricity that could not be cleared (i.e. the difference of unconstrained cleared volume and actual volume transacted) as % to unconstrained cleared volume from 2010-11 to 2012-13 and a declining trend from 2012-13 to 2019-20. Congestion for the volume of electricity transacted through power exchanges has been reduced since grid integration (integration of NEW Grid and SR Grid) in December 2013, which resulted a declining trend in the volume of electricity that could not be cleared as percentage to unconstrained cleared volume in both the power exchanges from 2013-14 onwards. In the latest 3 years i.e. 2017-18 and 2019-20, the volume of electricity that could not be cleared as % to unconstrained cleared volume was less than 1 per cent which shows that the congestion was insignificant.

Table-29: Effect of Congestion on the Volume of Electricity Transacted through Power Exchanges, 2009-10 to 2019-20

Year	Unconstrained Cleared Volume* (BU)	Actual Cleared Volume and hence scheduled (BU)	Volume of electricity that could not be cleared due to congestion (BU)	Volume of electricity that could not be cleared as % to Unconstrained Cleared Volume
1	2	3	4 (2-3)	5 (4/2)
2009-10	8.10	7.09	1.01	12%
2010-11	14.26	13.54	0.72	5%
2011-12	17.08	14.83	2.26	13%
2012-13	27.67	23.02	4.65	17%
2013-14	35.62	30.03	5.59	16%
2014-15	31.61	28.46	3.14	10%
2015-16	36.36	34.20	2.16	6%
2016-17	41.60	40.08	1.52	4%
2017-18	45.86	45.65	0.21	0.5%
2018-19	50.69	50.22	0.47	0.9%
2019-20	49.36	49.16	0.20	0.4%

** This power would have been scheduled had there been no congestion.*

Source: IEX & PXIL

During 2019-20, in IEX, the unconstrained cleared volume and the actual volume transacted was 49.31BU and 49.12BU respectively (Table-30). The actual transacted volume was 0.39% lesser than unconstrained volume. During the same year, in PXIL, the unconstrained cleared volume and the actual volume transacted were 0.049BU and 0.047BU respectively. The actual transacted volume was 5.28% lesser than unconstrained volume.

Table-30: Details of Congestion in Power Exchanges, 2019-20

	Items	IEX	PXIL	Total
A	Unconstrained Cleared Volume* (BU)	49.31	0.049	49.36
B	Actual Cleared Volume and hence scheduled (BU)	49.12	0.047	49.16
C	Volume of electricity that could not be cleared and hence not scheduled because of congestion (BU) (A-B)	0.19	0.003	0.20
D	Volume of electricity that could not be cleared as % to Unconstrained Cleared Volume	0.39%	5.28%	0.40%

** This power would have been scheduled had there been no congestion.*

Source: IEX & PXIL.

Transmission congestion, consequent market splitting, and the resultant difference in market prices in different regions give rise to congestion charges. The



annual congestion charges of both power exchanges for the period from 2008-09 to 2019-20 is provided in Table-31.

Table-31: Congestion Charges of Power Exchanges, 2008-09 to 2019-20

Year	Congestion Charges of IEX (₹ Crore)	Congestion Charges of PXIL (₹ Crore)	Total (₹ Crore)
2008-09	5.27	0.00	5.27
2009-10	255.40	22.39	277.79
2010-11	273.14	86.61	359.75
2011-12	419.13	65.62	484.76
2012-13	417.37	35.93	453.30
2013-14	387.23	5.10	392.33
2014-15	502.41	1.64	504.05
2015-16	214.08	0.14	214.22
2016-17	305.99	0.09	306.08
2017-18	56.56	0.003	56.56
2018-19	137.52	0.00	137.52
2019-20	55.65	0.00	55.65

Source: NLDC

10. Ancillary Services Operations

10.1 Background

Ancillary Services is one of the four essential pillars of Electricity Market design viz., Scheduling and Despatch, Imbalance Settlement, Congestion Management and Ancillary Services. Ancillary Services are support services to maintain power system reliability and support its primary function of delivering energy to customers. These are deployed by the system operator over various time frames to maintain the required instantaneous and continuous balance between aggregate generation and load. Ancillary Services consist of services required for (a) maintaining load-generation balance (frequency control); (b) maintaining voltage and reactive power support; (c) maintaining generation and transmission reserves. Historically, ancillary services were provided by the vertically integrated utilities along with the energy supply services. With the unbundling of vertically integrated utilities, increasing private sector

participation and competition introduced in energy markets, there is an increasing need for administering such services, so as to ensure reliable and secure grid operation. Ancillary Services are broadly classified as follows:

(i) **Frequency Control Ancillary Services (FCAS):** Three levels of Frequency Control are generally used to maintain the balance between generation and load i.e. Primary Frequency Control, Secondary Frequency Control, Tertiary Frequency Control. Three levels differ as per their time of response to a fluctuation and the methodology adopted to realize the fundamental operating philosophy of maintaining reliability and economy.

(ii) **Network Control Ancillary Services (NCAS):** This can be further subdivided into Voltage Control Ancillary Service and Power Flow Control Ancillary Services.

(iii) **System Restart Ancillary Services (SRAS):** It is used to restore the system after a full or partial blackout. Black start is vital and inexpensive service. Its costs are primarily the capital cost of the equipment used to start the unit, the cost of the operators, the routine maintenance and testing of equipment and the cost of fuel when the service is required. At present this is a mandatory service.

10.2 Regulatory Framework of Ancillary Services

Ancillary Services are defined, under Regulation (2)(1)(b) of the CERC (Indian Electricity Grid Code), Regulations, 2010 (IEGC), as follows: “...*in relation to power system (or grid) operation, the services necessary to support the power system (or grid) operation in maintaining power quality, reliability and security of the grid, e.g. active power support for load following, reactive power support, black start, etc; ...*”

The Commission notified the CERC (Ancillary Services Operations) Regulations on 13th August, 2015. The objective of Reserves Regulation Ancillary Services (RRAS) is to restore the frequency level at desired level and to relieve the congestion in the transmission network. Specifically, these regulations are the first step towards introducing Ancillary Services in the country that will enable the grid operator to ensure reliability and stability in the grid. The RRAS shall support both “Regulation

Up” service (that provides capacity by responding to signals or instruction of the Nodal Agency to increase generation) and “Regulation Down” service (that provides capacity by responding to signals or instruction of the Nodal Agency to decrease generation). The detailed procedures were laid out on the 08th March 2016 and Ancillary Services were implemented by the Nodal Agency i.e. NLDC in coordination with RLDCs from 12th April, 2016.

Regulation Up Service shall utilize “un-requisitioned surplus” of inter-State generating stations, whose tariff is determined or adopted by the Commission for their full capacity. Un-requisitioned surplus means the reserve capacity in a generating station that has not been requisitioned and is available for dispatch, and is computed as the difference between the declared capacity of the generating station and its total schedule under long-terms, medium-term and short-term transactions, as per the relevant regulations of the Commission. On the other hand, Regulation Down service may be provided by any eligible generator. Incentives for both the generators and their beneficiaries have been built into the framework.

As per the regulation, all the generators, that are regional entities, and whose tariff for the full capacity is determined or adopted by the CERC have been mandated to provide Ancillary Services as RRAS Providers. NLDC, through the RLDCs, has been designated as the Nodal Agency for Ancillary Services Operations. The Nodal Agency prepares the Merit Order Stack based on the variable cost of generation. Separate stacks are prepared for Up and Down.

Ancillary Services may be triggered because of extreme weather forecast, generating unit or transmission line outages, trend of load met, trend of frequency, any abnormal event such as outage of hydro generating units due to silt, coal supply blockade, etc., excessive loop flows leading to congestion, trend of computed Area Control Error (ACE) at regional level, recall by the original beneficiary, grid voltage profile at important nodes, ‘N-1’ criteria not being satisfied in a transmission corridor, loading of transmission lines beyond limits specified in CEA Manual on Transmission Planning Criteria.

A virtual regional entity called “Virtual Ancillary Entity (VAE)” has been created in the respective Regional Pool for scheduling and accounting. The quantum of RRAS instruction is incorporated in the schedule of RRAS providers. RRAS instruction may be scheduled to the VAE in any one or more regional grids. The deviation in schedule of the RRAS providers, beyond the revised schedule, is being settled as per the CERC Deviation Settlement Mechanism (DSM) Regulations. The energy dispatched under RRAS is deemed delivered ex-bus.

Nodal agency directs the RRAS provider to withdraw RRAS, on being satisfied, that the circumstances leading to triggering of RRAS services have ceased to exist. The RRAS energy accounting is being done by the respective Regional Power Committee (RPC) on weekly basis along with DSM account, based on interface meters data and schedule. A separate RRAS statement is being issued by RPC along with Regional DSM account. Any post-facto revision in rates/charges by RRAS providers is not permitted. In case of Regulation Up, fixed charges and variable charges along with pre-specified mark-up are payable to the RRAS providers from the pool. CERC, vide order dated 29th February 2016, specified the mark-up for participation in Regulation ‘Up’ as 50 paisa/kWh. In case of Regulation Down, 75 per cent of the variable charges are payable by RRAS providers to the pool. No commitment charges are payable to the RRAS provider.

10.3 RRAS Instructions issued by Nodal Agency

During 2019-20, the Nodal Agency has issued 6367 RRAS Up/Down instructions on account of various triggering criteria (Table-32). Of the total, there were 2801 RRAS Up instructions and 3566 RRAS Down instructions. Majority of the Regulation Up instructions and Regulation Down instructions were on account of multiple reasons followed by trend of load met, and high frequency.

Table-32: Number of times RRAS Triggered based on Triggering Criteria, 2019-20

Sr No.	Triggering Criteria	Regulation Up (Nos.)	Regulation Down (Nos.)	Total
1	Multiple reasons	1210	2076	3286



2	Trend of load met	1450	1354	2804
3	High Frequency	127	131	258
4	One or more transmission lines in the corridor are loaded beyond the normal limit	1	0	1
5	Extreme weather conditions	0	1	1
6	Increase in Solar Generation	0	2	2
7	Others	13	2	15
	Total	2801	3566	6367

Source: POSOCO Website

At times, the dispatch under Ancillary is not attributable to any single triggering criteria, and the operator has to specify “Others” as triggering criteria. There is a need to enhance the number of triggering criteria to provide more clarity and to encompass the dynamic behavior of the power system.

Table-33 provides month-wise details on maximum power despatched and maximum power regulated in a time block based on the instructions issued. It can be observed from the table that during the year 2019-20 in a time block, maximum power despatched was 3571 MW in November 2019 while the maximum power regulated was 3798 MW in March 2020.

Table-33: Maximum Ancillary Despatched in a Time Block (MW), 2019-20

Month	Max Regulation "UP"	Max Regulation "DOWN"
Apr-19	1389	2487
May-19	1940	1854
Jun-19	2217	2245
Jul-19	1830	3614
Aug-19	1855	3400
Sep-19	2510	2321
Oct-19	3517	2725
Nov-19	3571	2450
Dec-19	3309	3643
Jan-20	2962	2669
Feb-20	2962	2669
Mar-20	2709	3798

Source: POSOCO Website



10.4 RRAS Accounting and Settlement

As per Regulation 12 of the CERC (Ancillary Services Operations) Regulations 2015, the Regional Power Committees (RPCs) are required to issue the weekly accounts for RRAS along with the weekly DSM accounts. The RRAS accounts include fixed charges, variable charges, markup, amount of fixed charges to be refunded to the beneficiaries and the payments made from/to the DSM pool.

Energy scheduled to/from Virtual Ancillary Entity (VAE) under RRAS and the payments made for ancillary services during 2016-17 to 2019-20 has been provided in Table-34.

Table-34: Energy Scheduled and Payments Made for Ancillary Services, 2016-17 to 2019-20

Year	Energy scheduled to/from Virtual Ancillary Entity under RRAS (MU)		Payments made for Ancillary Services (₹ Crore)	
	Regulation UP	Regulation DOWN	To RRAS provider(s) from DSM Pool for Regulation UP	By RRAS provider(s) to DSM Pool for Regulation DOWN
2016-17	2212.28	286.00	939.78	42.39
2017-18	4149.25	243.72	2011.47	43.60
2018-19	4811.69	685.42	2810.73	140.83
2019-20	2435.01	1941.31	1333.36	398.40


Source: POSOCO Website

The energy scheduled under Regulation UP of RRAS was increased from 2212.28MU in 2016-17 to 2435.01 MU in 2019-20, whereas the energy scheduled under Regulation DOWN of RRAS was increased from 286.00MU in 2016-17 to 1941.31MU in 2019-20.

Month-wise energy scheduled to/from VAE under RRAS during 2019-20 can be seen in Figure-36. It can be observed from the figure that ancillary despatch under Regulation UP was relatively high when compared with the ancillary despatch under



Regulation DOWN during May, June, September, October, November 2019 and January 2020.

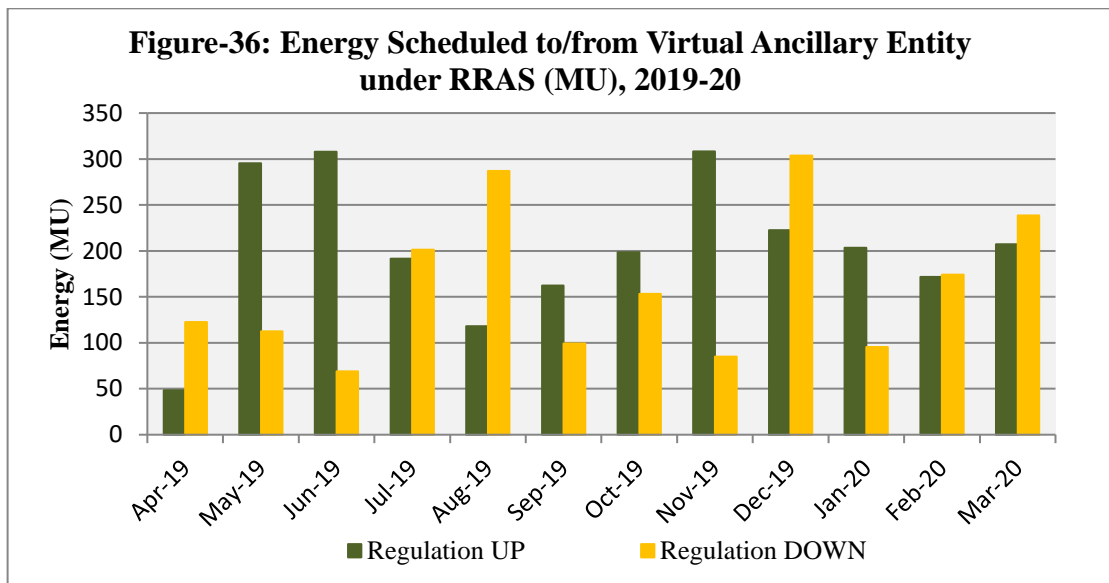

Presently, the Ancillary Services implementation is load-following and for congestion management. The RRAS is primarily a framework for tertiary reserves, therefore, there is a need for enhancing the adequacy of reserves with shorter time of response.

For stable frequency operation and security of the grid, the Automatic Generation Control (AGC) is used as one of the steps for Secondary Control. The Commission in its order dated 06.12.2017 approved the Commissioning of the AGC Pilot Project between NLDC and NTPC Dadri Stage-II, which has been in continuous operation from 1225 Hrs. of 04.01.2018. The response of the generator for variation in Area Control Error (ACE) due to deviations in tie line flows of Northern Region and frequency was observed in the pilot project. The Commission also directed that similar pilot projects may be replicated by NLDC, in at least one other regional grid of the country. Accordingly, four more AGC pilot projects have been implemented viz. Simhadri Stage-II in Southern Region, Mauda Stage-II in Western Region, Barh Stage-II in Eastern Region and Bongaigaon in North-Eastern Region.

The Commission after gaining valuable experience through pilot projects, envisages large scale implementation of AGC as a step forward. Vide its order dated 28.08.2019, the Commission has directed all thermal Inter State Generating Stations that are regional entities with installed capacity of 200 MW and above and all hydro stations with capacity exceeding 25 MW (excluding the Run-of-River Hydro Projects) and whose tariff is determined or adopted by the Commission, to install the required software for implementation of AGC at the unit control rooms for transferring the required set of data for AGC. Further the Central Transmission Utility and the NLDC are also directed to commission the required communication system in parallel.

Secondary control is the control area (Region considered as area) wise automatic control which delivers reserve power in order to bring back the frequency and the area interchange programs to their target values. In doing so, the delivered primary control reserves are restored on those machines which have contributed to primary response. The AGC implemented projects have the ability to follow signals given directly by the system operator (POSOCO), to regulate variation in ACE by increasing/decreasing generation. The response time is quick and automated, in the range of few minutes.

The Commission, vide order dated 16.07.2018, endorsed implementation of another pilot project on Hydro power stations, for Fast Response Ancillary Services (FRAS). The present framework of Ancillary Services predominantly utilizes the thermal power stations which have ramping limitations and as such there is a need for a fast response ancillary service. After gaining experience from this pilot project, similar projects may be replicated for better ancillary services.

Chapter-III

Cross Border Trade of Electricity

1. Background

“Cross Border Trade of Electricity” means the transactions involving import or export of electricity between India and its neighbouring countries. The cross border trade of electricity between India and Nepal and between India and Bhutan has been taking place for many years. India has started exporting of electricity to Bangladesh in 2013 and to Myanmar in 2017. The cross border trade of electricity has expanded significantly since the year 2013.

At present, cross border trade of electricity has been taking place under bilateral Memorandum of Understanding/Power Trade Agreement. The South Asian Association for Regional Cooperation (SAARC) countries envisaged the need for cross border electricity cooperation and signed the SAARC Framework Agreement for Energy Cooperation on 27.11.2014, recognizing the importance of electricity in promoting economic growth and improving the quality of life in the region. In order to facilitate and promote cross border trade of electricity with greater transparency, consistency and predictability in regulatory approaches across jurisdictions and to minimize perception of regulatory risks, the Guidelines on Cross Border Trade of Electricity have been prepared by the Inter-Ministerial Working Group in consultation with various stakeholders.

The Ministry of Power issued the Guidelines on Cross Border Trade of Electricity on 05.12.2016, which was subsequently substituted by the ‘Guidelines for Import/Export (Cross Border) of Electricity-2018’ issued on 18.12.2018, to promote cross border trade of electricity with neighbouring countries. Following the guidelines, the Central Electricity Regulatory Commission has issued the CERC (Cross Border Trade of Electricity) Regulations, 2019 on 8th March 2019. The Central Electricity Authority has issued “Draft Conduct of Business Rules of the Designated Authority” on 25th April 2019 for facilitating the cross border trade of electricity.



Under the CERC (Cross Border Trade of Electricity) Regulations 2019, sale and purchase of electricity between India and the neighbouring countries will be allowed through mutual agreements between the local entities and the entities of the neighboring countries, through bilateral agreements between two countries, bidding route or through mutual agreements between entities. Any Indian trader, after obtaining approval from Designated Authority, can trade in Indian Power Exchanges on behalf of any Entity of neighbouring country complying with these regulations.

2. Growth of Cross Border Trade of Electricity

Table-35 provides the details on growth of cross border trade of electricity between India and its neighbouring countries during the period from 2013-14 to 2019-20. It can be observed from the table that India has been importing electricity from Bhutan and exporting electricity to Nepal, Bangladesh and Myanmar. It can also be observed from the table that India was net importer of electricity during the period from 2013-14 to 2015-16 and net exporter of electricity during the period from 2016-17 to 2019-20. The net export of electricity by India has been increasing.

Table-35: Growth of Cross Border Trade of Electricity, 2013-14 to 2019-20 (BU)

Year	Bhutan (+)	Nepal (-)	Bangladesh (-)	Myanmar (-)	Net Export/Import by India
2013-14	5.56	0.84	1.45	0.00	3.27
2014-15	5.11	1.00	3.27	0.00	0.84
2015-16	5.56	1.47	3.65	0.00	0.43
2016-17	5.86	2.02	4.42	0.00	-0.58
2017-18	5.61	2.39	4.81	0.01	-1.59
2018-19	4.66	2.80	5.69	0.01	-3.84
2019-20	6.31	2.37	6.99	0.01	-3.06

(+) Import; (-) Export

Source: POSOCO

India has gradually strengthened its position as an electricity exporting nation and has been exporting electricity to Bangladesh, Nepal, and Myanmar. India can

further strengthen its position once the cross border trade of electricity is started on power exchanges in addition to the trade through existing trading arrangements.



Chapter-IV

Tariff of Long-term Sources of Power

1. Background

Section 61 & 62 of the Electricity Act, 2003 provide for tariff regulation and determination of tariff of generation, transmission, wheeling and retail sale of electricity by the Appropriate Commission. The CERC has the responsibility to regulate the tariff of generating companies owned or controlled by the Central Government. The CERC specifies the terms and conditions for the determination of tariff for the generating companies guided by the principles and methodologies specified. The principles of the tariff are based on (a) the factors which would encourage competition, efficiency, economical use of the resources, good performance and optimum investments; (b) safeguarding of consumers' interest and at the same time, recovery of the cost of electricity in a reasonable manner; (c) rewarding efficiency in performance; (d) the tariff progressively reflects the cost of supply of electricity and also, reduces and eliminates cross-subsidies; (e) the promotion of co-generation and generation of electricity from renewable sources of energy; etc.

Section 63 of the Act states that “Notwithstanding anything contained in section 62, the Appropriate Commission shall adopt the tariff if such tariff has been determined through transparent process of bidding in accordance with the guidelines issued by the Central Government” in line with the Ministry of Power notified competitive bidding guidelines in 2005. The guidelines are being issued for procurement of electricity by distribution licensees for (a) long-term procurement of electricity for a period of 7 years and above; and (b) medium-term procurement for a period of upto 7 years but exceeding 1 year. The guidelines shall apply for procurement of base-load, peak load and seasonal power requirements through competitive bidding, through the mechanisms: (i) where location, technology, or fuel is not specified by the procurer (Case-1); and (ii) for hydro-power projects, load center projects or other location specific projects with specific fuel allocation such as captive mines available, which the procurer intends to set up under tariff based bidding process (Case-2).



The power procurement through competitive bidding resulted in significant capacity addition by private sector. The details on tariff determined by CERC for inter-state power generating companies, mainly the tariff of central public sector power generating companies, have been provided below.

2. Tariff of Central Public Sector power generating companies

In 2019-20, the central public sector power generating companies (NTPC, NHPC, NLC, NEEPCO, etc.)/central government owned generating companies accounted for about 37% of the total power generation in the country. The entire generation of these central government owned generating companies is being procured by various distribution companies through long-term Power Purchase Agreements.

The price paid by distribution companies to procure power from central government owned generating companies in 2019-20 is shown in Table-36 and 37. It can be seen that, on an average, the distribution companies paid between ₹2.01 and ₹5.75 per kWh for procuring power from coal based stations, between ₹3.68 and ₹6.37 per kWh from gas based power stations, (Table-36), and between ₹1.16 per kWh and ₹8.46 per kWh from hydro stations (Table-37).

Table-36: Tariff of Central Thermal Power Stations, 2019-20*

Sl. No.	Name of the Generating Station	Installed Capacity (MW) as on March, 2020	Fixed charges (₹/ kWh)	Energy Charges (₹/ kWh)	Total Tariff (₹/ kWh)
I: Coal Based thermal generating Stations of NTPC					
A.	Pit head Generating Stations				
1	Rihand STPS (St-I)	1000	0.84	1.36	2.21
2	Rihand STPS (St-II)	1000	0.70	1.36	2.06
3	Rihand STPS (St-III)	1000	1.44	1.34	2.78
4	Singrauli STPS	2000	0.65	1.36	2.01
5	Farrakka STPS (St-I&II)	1600	0.82	2.54	3.36
6	Farrakka STPS (St-III)	500	1.49	2.50	3.99
7	Kahalgaon STPS (St-I)	840	1.05	2.19	3.24
8	Kahalgaon STPS (St-II)	1500	1.09	2.08	3.17

9	Vindhyachal STPS (St-I)	1260	0.85	1.78	2.63
10	Vindhyachal STPS (St-II)	1000	0.70	1.70	2.40
11	Vindhyachal STPS (St-III)	1000	1.04	1.70	2.74
12	Vindhyachal STPS (St-IV)	1000	1.56	1.68	3.24
13	Vindhyachal STPS (St-V)	500	1.67	1.71	3.38
14	Korba STPS (St-I & II)	2100	0.68	1.36	2.04
15	Korba STPS (St-III)	500	1.38	1.33	2.71
16	Ramagundam STPS (St-I&II)	2100	0.73	2.60	3.33
17	Ramagundam STPS (St-III)	500	0.77	2.56	3.32
18	Talcher TPS	460	1.44	1.87	3.31
19	Talcher STPS (St-I)	1000	0.96	2.02	2.98
20	Talcher STPS (St-II)	2000	0.71	2.00	2.71
21	Sipat STPS (St-I)	1980	1.30	1.43	2.73
22	Sipat STPS (St-II)	1000	1.23	1.47	2.70
23	Lara STPS (St-I)	800	1.96	2.46	4.42
24	Darlipalli STPS (St-I)	800	2.11	1.19	3.30
	Sub-Total (A)	27440			
B.	Non-Pit head Generating Stations				
25	FGUTPS (St-I)	420	1.08	3.53	4.60
26	FGUTPS (St-II)	420	1.01	3.57	4.58
27	FGUTPS (St-III)	210	1.34	3.54	4.88
28	FGUTPS (St-IV)	500	1.55	3.39	4.95
29	NCTP Dadri (St-I)	840	0.97	4.13	5.10
30	NCTP Dadri (St-II)	980	1.43	3.75	5.18
31	Tanda TPS (St-I)	440	1.26	3.17	4.43
32	Tanda TPS (St-II)	660	1.60	2.66	4.26
33	Simhadri STPS (St-I)	1000	0.94	3.28	4.22
34	Simhadri STPS (St-II)	1000	1.52	3.22	4.74
35	Mauda STPS (St-I)	1000	1.87	3.27	5.15
36	Mauda STPS (St-II)	1320	1.48	3.22	4.70
37	Barh STPS (St-II)	1320	1.84	2.46	4.30
38	Bongaigaon TPS	750	2.40	3.35	5.75
39	Solapur STPS	1320	1.72	3.42	5.14
40	Kudgi STPS	2400	1.66	3.71	5.37
41	Barauni TPS (St-I)	220	1.15	3.21	4.37
42	Barauni TPS (St-II)	250	2.38	2.27	4.65
43	Gadarwara STPS (St-I)	800	1.98	3.32	5.31
44	Khargone STPS (St-I)	660	2.06	2.93	4.99
	Sub-Total (B)	16510			



	Total Coal (A+B)	43950			
II: Gas based Power Generating Stations of NTPC					
1	Anta CCGT	419	0.71	5.66	6.37
2	Auraiya GPS	663	0.63	4.07	4.70
3	Dadri CCGT	830	0.58	4.42	5.00
4	Faridabad GPS	432	0.74	3.17	3.91
5	Gandhar GPS	657	1.06	3.05	4.11
6	Kawas GPS	656	0.84	2.84	3.68
7	Kayamkulam RGPS	360	1.14	Not Scheduled	
	Total	4017			
III: Gas based Power Generating Stations of NEEPCO					
1	Agartala GPS	84	1.54	2.58	4.13
2	Assam GPS	291	1.85	1.99	3.83
	Total NEEPCO	375			
IV: Lignite Based thermal generating Stations of NLC					
1	TPS-I	600	0.93	2.52	3.45
2	TPS-II Stage-I	630	0.72	2.33	3.05
3	TPS-II Stage-II	840	0.75	2.33	3.08
4	TPS-I (Expansion)	420	0.94	1.95	2.89
5	TPS-II (Expansion)	500	2.22	2.91	5.13
6	Barsingsar TPS	250	2.02	1.21	3.23
	Total NLC	3240			
V: Other Inter-state Coal based Power Generating Stations					
1	Indira Gandhi STPP, Stage-I	1500	1.55	2.32	3.87
2	Vallur TPP	1500	1.65	1.90	3.56
3	NTPL TPS	1000	1.46	2.10	3.56
4	Maithon Right Bank TPP	1050	1.39	2.41	3.79
5	Kamalanga Power Plant	1050	1.61	1.17	2.78
	Total	6100			
VI: Other Inter-state Gas based Power Generating Stations					
1	OTPC Ltd	727	1.70	1.19	2.89
2	Pragati Power Plant-III	1371	1.45	2.97	4.42
	Total	2098			

* Tariff is not determined yet for the year 2019-20, therefore, tariff allowed for billing is provided. This is in accordance with the Regulation 10 (4) of the Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2019.

Table-37: Composite Tariff of Central Hydro Power Stations, 2019-20*

Sr. No.	Name of the Generating Company/ Station	Type	Installed Capacity (MW)	Design Energy (MU)	Annual Fixed Charges (₹/Crore)	Composite Tariff (₹/kWh)
	NHPC					
1	Baira siul	Pondage	180	779	138	2.03
2	Loktak	Storage	105	448	150	3.84
3	Salal	ROR	690	3082	331	1.23
4	Tanakpur	ROR	123	452	130	3.29
5	Chamera-I	Pondage	540	1665	330	2.28
6	Uri-I	ROR	480	2587	370	1.64
7	Rangit	Pondage	60	339	112	3.80
8	Chamera-II	Pondage	300	1500	262	2.01
9	Dhauliganga-I	Pondage	280	1135	240	2.43
10	Dulhasti	ROR	390	1907	912	5.50
11	Teesta-V	Pondage	510	2572	520	2.32
12	Sewa-II	Pondage	120	534	199	4.33
13	Chamera-III	Pondage	231	1086	405	4.25
14	Chutak	ROR	44	213	145	7.85
15	Uri-II	ROR	240	1124	469	4.86
16	Nimoo Bazgo	Pondage	45	239	176	8.46
17	Teesta-LDP-III	Pondage	132	594	361	6.20
18	Teesta-LDP-IV	Pondage	160	581	162	2.56
19	Parbati-III	ROR	520	1977	520	3.02
	Total		5150	22814		
	NHDC					
1	Indira Sagar	Storage	1000	2247	529	2.70
2	Omkareshwar	Storage	520	957	398	4.78
	Total		1520	3204		
	THDC					
1	Tehri HPP Stage-I	Storage	1000	2767	1292	5.36
2	Koteshwar HEP	RoR with Pondage	400	1155	466	4.63
	Total		1400	3922		
	SJVNL					
1	Naptha Jhakri	RoR	1500	6924	1345	2.23
2	Rampur HP	RoR	412	1878	697	4.27
	Total		1912	8802		
	NEEPCO					
1	Kopili HEP Stage-I	Storage	200	1186	120	1.16

2	Kopili HEP Stage-II	Storage	25	86	12	1.63
3	Khandong	Storage	50	278	44	1.81
4	Doyang	Storage	75	227	108	5.48
5	Ranganadi HEP	Pondage	420	1874	273	1.67
	Total		770	3651		

** Tariff is not determined yet for the year 2019-20, therefore, tariff allowed for billing is provided. This is in accordance with the Regulation 10 (4) of the Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2019.*

Chapter-V

Trading of Renewable Energy Certificates

1. Renewable Energy Certificate Mechanism

The Renewable Energy Certificate (REC) mechanism is a market based instrument, to promote renewable sources of energy and development of market in electricity. The REC mechanism provides an alternative voluntary route to a generator to sell his electricity from renewable sources just like conventional electricity and sell the green attribute separately to obligated entities to fulfill their Renewable Purchase Obligation (RPO). Such a generator can either opt to enter into a Power Purchase Agreement for sale at preferential full cost tariff to a distribution licensee or can opt to take the REC route for such untied capacity. If he opts for the REC route, he can sell his electricity to a distribution licensee such as a conventional source based generation at an average power purchase cost. Or, he can sell to a third party, that is, to an open access consumer at mutually settled prices, or even on power exchanges. On every one megawatt hour of such electricity generated, he is entitled to get one REC from the central registry (which is regulated by the CERC) after getting registered once with this registry. Such registration requires prior accreditation with the state nodal agency for verifying the source of generation, capacity, and grid metering.

There are two categories of RECs, solar and non-solar, to meet the RPO of the corresponding category. This is because the cost of solar-based generation is very high compared to all other sources. The RE generator as an eligible entity shall apply for issuance of REC within 6 months from the month in which RE power was generated and injected into the grid. The central agency shall issue the RECs to the eligible entity within 15 working days from the date of physical receipt of the application by the eligible entity. The issued REC is valid for 1095 days. It is to be sold on power exchanges regulated by CERC, which also fixes a price band for exchange of REC (the band of forbearance price and floor price) to protect the interests of obligated entities and generators, respectively. Obligated entities can fulfill RPO by purchasing renewable electricity at full cost preferential tariff or by purchasing REC equivalent to their RPO.



Voluntary buyers can also purchase REC. Regulatory charge for shortfall of RPO compliance is at the rate of forbearance price.

The Central Electricity Regulatory Commission (Terms and Conditions for recognition and issuance of Renewable Energy Certificate for Renewable Energy Generation) Regulations, 2010 were issued on 14th January, 2010 for the development of market in power from Non Conventional Energy Sources by issuance of transferable and saleable credit certificates. These Regulations shall apply throughout India except the State of Jammu and Kashmir. The CERC has nominated NLDC as the Implementing Agency (for the Central Registry), which prepares procedures and a web-based platform for the REC mechanism. The REC mechanism was formally launched on 18 November 2010.

2. Trading of Renewable Energy Certificates

Trading of RECs is being undertaken on Power Exchanges on the last Wednesday of every month. In the event of a bank holiday on the last Wednesday of any month, trading shall take place on the next bank working day. If there are other exigencies warranting change in the day for trading, the Central Agency can make such change as considered necessary under intimation to all concerned. The bidding window is open on the Power Exchanges designated for dealing in the RECs from 13:00 Hrs to 15:00 Hrs on the day of trading.

One REC is equivalent to 1 MWh of electricity injected into the grid from renewable energy sources. The REC is exchanged only in the power exchanges approved by CERC within the band of a floor price and forbearance (ceiling) price as notified by CERC from time to time (Table-38).

Table-38: Floor and Forbearance Price applicable for REC Transactions

Applicable Period	Floor Price (₹/MWh)		Forbearance Price (₹/MWh)	
	Solar	Non-Solar	Solar	Non-Solar
w.e.f 1st June 2010	12000	1500	17000	3900
w.e.f 1st April 2012	9300	1500	13400	3300



w.e.f 1st March 2015	3500	1500	5800	3300
w.e.f 1st April 2017	1000	1000	2400	3000

The first REC trading session was held on power exchanges in March 2011. The growth of RECs transacted on power exchanges has been provided in Table-39. The number of RECs increased significantly from 10.15 lakh in 2011-12 to 162.00 lakh in 2017-18 and then declined to 89.28 lakh in 2019-20. Similar trend can be seen in the number of buyers and sellers during the period. A negative growth can be observed in number of RECs transacted in 2018-19 and 2019-20. This could be for the reason that the state utilities may be buying more RE power directly from the RE power generators which may be relatively cheaper than buying RECs and non-RE power.

Table-39: Growth of RECs transacted on Power Exchanges, 2011-12 to 2019-20

Year	Number of buyers	Number of sellers	Number of RECs transacted (Lakhs)	% increase in Number of RECs Transacted
2011-12	397	197	10.15	-
2012-13	802	683	25.90	155%
2013-14	1083	1044	27.49	6%
2014-15	821	1378	30.62	11%
2015-16	1332	1512	49.55	62%
2016-17	1760	1588	64.88	31%
2017-18	1140	1088	162.00	150%
2018-19	988	830	126.00	-22%
2019-20	830	820	89.28	-29%

Note: The buyers/sellers can transact through any of the Power Exchange.

Source: NLDC

Table-40 shows the demand and supply of RECs (i.e. the gap between the volume of buy and sell bids of RECs) on power exchanges during 2012-13 to 2019-20. It can be observed from the table that the volume of buy bid as percentage of volume of sell bid declined from 2012-13 to 2016-17 in both power exchanges, which indicates that the demand for both Solar and Non-Solar RECs has declined during the period. The percentage was increased from 2016-17 to 2019-20, which indicates that the

demand for both Solar and Non-Solar RECs has increased. In 2019-20, the demand for solar RECs was relatively high when compared with the demand for non-solar RECs.

Table-40: Demand and Supply of RECs transacted on Power Exchanges, 2012-13 to 2019-20

Year	IEX			PXIL		
	Volume of Buy Bid of RECs (Lakhs)	Volume of Sell Bid of RECs (Lakhs)	Volume of Buy Bid as % of volume of Sell Bid	Volume of Buy Bid of RECs (Lakhs)	Volume of Sell Bid of RECs (Lakhs)	Volume of Buy Bid as % of volume of Sell Bid
Solar						
2012-13	0.77	0.14	549%	0.12	0.05	265%
2013-14	0.54	5.86	9%	0.14	1.35	10%
2014-15	1.01	37.00	3%	0.63	33.46	2%
2015-16	4.65	227.67	2%	1.83	93.80	2%
2016-17	4.04	323.70	1%	1.53	147.66	1%
2017-18	0.89	34.99	3%	1.20	13.68	9%
2018-19	86.45	152.51	57%	44.46	99.85	45%
2019-20	71.49	19.45	367%	26.80	8.12	330%
Non Solar						
2012-13	24.35	91.85	27%	6.55	24.90	26%
2013-14	12.71	251.65	5%	14.11	172.33	8%
2014-15	14.47	553.25	3%	14.51	550.88	3%
2015-16	26.73	889.92	3%	16.34	644.01	3%
2016-17	42.15	981.50	4%	17.16	596.37	3%
2017-18	94.17	635.09	15%	67.89	324.13	21%
2018-19	88.05	60.43	146%	37.82	16.53	229%
2019-20	91.87	94.72	97%	46.71	48.15	97%

The volume and price of RECs transacted on both power exchanges during 2012-13 to 2019-20 has been provided in Table-41. It can be observed from the table that there is an increasing trend in the volume of both solar and non-solar RECs transacted on both power exchanges and there is a declining trend in the weighted average of market clearing price of the RECs. The increase in the volume of RECs transacted on power exchanges can be attributed to the increase in the RPO compliance. Decline in the price of RECs can be attributed to the demand and supply of RECs and the REC regulations issued by CERC from time to time i.e. by reducing the floor and forbearance price.

The market clearing volume of Solar RECs transacted on both power exchanges increased from 0.14 lakhs in 2012-13 to 23.15 lakhs in 2019-20, whereas the weighted average of market clearing price of these RECs declined from ₹12740/MWh in 2012-13 to ₹2293/MWh in 2019-20. The market clearing volume of Non-Solar RECs transacted on both power exchanges increased from 25.76 lakhs in 2012-13 to 64.88 lakhs in 2019-20, whereas the weighted average of market clearing price of these RECs declined from ₹1692/MWh in 2012-13 to ₹1642/MWh in 2019-20.

Table-41: Volume and Price of RECs transacted on Power Exchanges, 2012-13 to 2019-20

Month	IEX		PXIL		Total	
	Volume of RECs (MWh) in Lakhs	Weighted Average Price of RECs (₹/MWh)	Volume of RECs in Lakhs	Weighted Average Price of RECs (₹/MWh)	Volume of RECs in Lakhs	Weighted Average Price of RECs (₹/MWh)
Solar						
2012-13	0.10	12782	0.04	12615	0.14	12740
2013-14	0.53	9383	0.14	9668	0.67	9441
2014-15	1.01	3725	0.63	4756	1.64	4121
2015-16	4.65	3500	1.83	3500	6.48	3500
2016-17	4.04	3500	1.53	3500	5.57	3500
2017-18	0.89	1000	1.20	1000	2.08	1000
2018-19	46.59	1113	25.36	1067	71.95	1097
2019-20	17.11	2293	6.04	2292	23.15	2293
Non-Solar						
2012-13	19.81	1731	5.95	1564	25.76	1692
2013-14	12.71	1500	14.11	1500	26.82	1500
2014-15	14.47	1500	14.51	1500	28.98	1500
2015-16	26.73	1500	16.34	1500	43.07	1500
2016-17	42.15	1500	17.16	1500	59.31	1500
2017-18	92.41	1480	67.35	1487	159.76	1483
2018-19	41.22	1298	10.77	1274	51.98	1293
2019-20	43.16	1634	21.71	1659	64.88	1642

Consequent to the revised floor and forbearance price issued by CERC vide order dated 30.03.2017, the Supreme Court had put stay on trading of the RECs. While trading of Non-Solar RECs was allowed conditionally from July 2017 onwards, trading

of Solar RECs was suspended till March 2018. After the APTEL Judgement, vide order dated 12.04.2018, the trading of Solar RECs resumed after a gap of one year i.e. in the month of April 2018. As majority of the RECs expired/were likely to expire soon, the CERC extended the validity of the RECs up to 31.03.2018. Keeping in view large inventory of RECs, the CERC has further extended the validity of the RECs up to 31st December 2019 and up to 31st March 2020 through its order dated 30.04.2019 and 30.12.2019, respectively.

In May 2018, Ministry of New and Renewable Energy, vide order dated 22.05.2018, created the RPO Compliance Cell, with a function to coordinate with States, CERC and SERCs on matters relating to RPO compliance and taking up non-compliance issues with appropriate authorities. Further in June 2018, Ministry of Power notified the long term growth trajectory of RPOs for Solar and Non solar for a period of three years from 2019-20 to 2021-22 (Table-42).

Table-42: Long-term Growth Trajectory of RPOs, 2019-20 to 2021-22

Type of RPOs	2019-20	2020-21	2021-22
Non-Solar	10.25%	10.25%	10.50%
Solar	7.25%	8.75%	10.50%
Total	17.50%	19.00%	21.00%

List of Transmission Licensees as on 31.03.2020

S.No.	Name of Licensee	Date of grant of licence
1	Powerlinks Transmission Ltd.	13.11.2003
2	Torrent Power Grid Ltd	16.05.2007
3	Jaypee Powergrid Ltd	01.10.2007
4	Essar Power Transmission Company Ltd.	10.04.2008
5	Parbati Koldam Transmission Company Ltd	15.09.2008
6	Western Region Transmission (Maharashtra) (P) Ltd	30.12.2008
7	Western Region Transmission (Gujrat) (P) Ltd	30.12.2008
8	Teestavalley Power Transmission Ltd	14.05.2009
9	North East Transmission Company Ltd	16.06.2009
10	East - North Inter - Connection Company Ltd.	28.10.2010
11	Talcher - II Transmission Company Ltd.	08.11.2010
12	Cross Border Power Transmission Company Ltd	01.12.2010
13	North Karanpura Transmission Company Ltd.	16.12.2010
14	Jindal Power Ltd	09.05.2011
15	Raichur Sholapur Transmission Company Ltd	24.08.2011
16	Jabalpur Transmission Company Ltd	12.10.2011
17	Bhopal Dhule Transmission Company Ltd	12.10.2011
18	Powergrid NM Transmission Ltd	20.06.2013
19	Torrent Energy Ltd	16.07.2013
20	Adani Transmission (India) Ltd	29.07.2013
21	Aravali Power Co. Ltd.	07.11.2013
22	Kudgi Transmission Ltd	07.01.2014
23	Powergrid Vizag Transmission Ltd	08.01.2014
24	Darbhangha - Motihari Transmission Company Ltd	30.05.2014
25	Purulia & Kharagpur Transmission Company Ltd	30.05.2014
26	Patran Transmission Company Ltd	14.07.2014
27	Powergrid Unchahar Transmission Ltd	21.07.2014
28	RAPP Transmission Company Ltd	31.07.2014
29	NRSS XXXI (B) Transmission Ltd	25.08.2014
30	Powergrid Kala Amb Transmission Ltd (NRSS XXXI (A) Transmission Ltd)	04.09.2014
31	NRSS XXIX Transmission Ltd (Sterlite)	14.11.2014
32	Powergrid Jabalpur Transmission Ltd	15.06.2015
33	DGEN Transmission Company Ltd	24.06.2015
34	Powergrid Parli Transmission Ltd (Gadarwara (B) Transmission Ltd)	10.07.2015

35	POWERGRID Warora Transmission Ltd	05.08.2015
36	Maheshwaram Transmission Ltd	23.11.2015
37	Raipur-Rajandgaon-Warora Transmission Ltd	29.02.2016
38	Chhattisgarh-WR Transmission Ltd	29.02.2016
39	Sipat Transmission Ltd	07.03.2016
40	POWERGRID Southern Interconnector Transmission System Ltd	14.03.2016
41	Alipurduar Transmission Ltd	21.03.2016
42	Odisha Generation Phase-II Transmission Ltd	30.06.2016
43	Gurgaon Palwal Transmission Ltd	29.09.2016
44	Warora-Kurnool Transmission Ltd	29.09.2016
45	North Karanpura Transco Ltd	29.09.2016
46	Khargone Transmission Ltd	17.11.2016
47	NRSS XXXVI Transmission Ltd	07.12.2016
48	NER-II Transmission Ltd	20.06.2017
49	Powergrid Medinipur Jeerat Transmission Ltd	20.06.2017
50	Kohima-Mariani Transmission Ltd	10.07.2017
51	Powergrid Mithilanchal Transmission Limited (ERSS XXI Transmission Ltd)	24.04.2018
52	Goa - Tamnar Transmission Project Ltd	13.07.2018
53	Fatehgarh-Bhadla Transmission Ltd	27.08.2018
54	Powergrid Varanasi Transmission Ltd (WR-NR Power Transmission Ltd)	27.08.2018
55	Powergrid Khetri Transmission System Limited	19.12.2019
56	Bikaner-Khetri Transmission Limited	27.12.2019
57	Udupi Kasargode Transmission Limited (UKTL)	24.01.2020
58	WRSS XXI (A) Transco Limited	24.01.2020
59	Power Grid Bhuj Transmission Limited (PBTL)	03.03.2020
60	Lakadia Banaskantha Transco Limited	03.03.2020
61	Powergrid Ajmer Phagi Transmission Limited (PAPTL)	04.03.2020
62	Powergrid Fatehgarh Transmission Limited (PFTL)	04.03.2020
63	Lakadia Vadodara Transmission Project Limited (LVTPL)	04.03.2020

List of Trading Licensees as on 31.03.2020

Sr. No.	Name of Trading Licensee	Date of Issue of License	Category of License*
1	Tata Power Trading Company Ltd	09-06-2004	I
2	Adani Enterprises Ltd	09-06-2004	I
3	PTC India Ltd	30-06-2004	I
4	NTPC Vidyut Vyapar Nigam Ltd	23-07-2004	I
5	National Energy Trading & Services Ltd	23-07-2004	I
6	Instinct Infra & Power Ltd	07-09-2005	III
7	Essar Electric Power Development Corporation Ltd	14-12-2005	II
8	JSW Power Trading Company Ltd.	25-04-2006	I
9	Greenko Energies (P) Ltd	22-01-2008	III
10	Ambitious Power Trading Company Ltd	16-09-2008	IV
11	RPG Power Trading Company Ltd	23-09-2008	II
12	GMR Energy Trading Ltd	14-10-2008	I
13	Shyam Indus Power Solutions (P) Ltd	11-11-2008	III
14	Global Energy (P) Ltd.	28-11-2008	I
15	Knowledge Infrastructure Systems (P) Ltd	18-12-2008	I
16	Kreate Energy (I) Pvt. Ltd.	12-02-2009	II
17	Shree Cement Ltd	16-03-2010	II
18	Jai Prakash Associates Ltd	23-03-2011	I
19	ABJA Power Pvt. Ltd.	26-04-2011	III
20	Customised Energy Solutions India (P) Ltd	08-06-2011	III
21	Statkraft Markets (P) Ltd	21-06-2012	I
22	Manikaran Power Ltd	29-06-2012	I
23	Arunachal Pradesh Power Corporation (P) Ltd	11-09-2012	II
24	Vedprakash Power (P) Ltd	19-08-2013	IV
25	Solar Energy Corporation of India	01-04-2014	I
26	Saranyu Power Trading Pvt. Ltd (Earlier IPCL Power Trading (P) Ltd)	10-02-2015	III
27	Gita Power & Infrastructure (P) Ltd	20-10-2015	III
28	Phillip Commodities India Pvt. Ltd.	21-01-2016	IV

29	Renew Solar Services Pvt. Ltd.	27-01-2017	IV
30	Atria Energy Services Private Limited	20-06-2017	IV
31	NHPC Limited	23-04-2018	I
32	NLC India Ltd.	13-07-2018	I
33	Refex Energy Ltd.	30-08-2018	I
34	NTPC Limited	08-07-2019	I

** The Category of the licensees is as on 30.01.2020 as per the Trading License Regulations 2009. The existing licensees shall comply the qualification as per the CERC Trading License Regulations 2020 within six months from the date of commencement of these regulations. Therefore, the Category of licensees may change subject to compliance of qualifications as per the Trading License Regulations 2020.*

Historical Volatility Formula:

$$\sigma = \sqrt{\frac{1}{(n-1)} \sum_{y=1}^n \left(\ln \frac{y_i}{y_{i-1}} - \mu \right)^2}$$

$$\mu = \frac{1}{n} \sum_{y=1}^n \left(\ln \frac{y_i}{y_{i-1}} \right)$$

where

1. Daily prices returns = $\ln (y_i / y_{i-1})$.
2. y_i is price for today; y_{i-1} is price on previous day.
3. \ln is natural logarithm
4. n is the number of observations
5. μ is the average daily returns

Herfindahl-Hirschman Index (HHI)

Formula for computing the HHI is as under:

$$\text{HHI} = \sum_{i=1}^N s_i^2$$

where s_i is the market share of firm i in the market, and N is the number of firms.

The Herfindahl-Hirschman Index (*HHI*) ranges from $1/N$ to one, where N is the number of firms in the market. Equivalently, if percents are used as whole numbers, as in 75 instead of 0.75, the index can range up to 100^2 or 10,000.

- HHI below 0.01 (or 100) indicates a highly competitive index.
- HHI below 0.15 (or 1,500) indicates an unconcentrated index.
- HHI between 0.15 to 0.25 (or 1,500 to 2,500) indicates moderate concentration.
- HHI above 0.25 (above 2,500) indicates high concentration.

There is also a normalized Herfindahl index. Whereas the Herfindahl index ranges from $1/N$ to one, the normalized Herfindahl index ranges from 0 to 1.